



PLOT DATE: Wednesday, October 25, 2023 1:04 PM LAST SAVED BY: DLE
DRAWING LOCATION: G:\LE\22.1447-Fulenwider PA9 Development\PLANS\EXHIBITS\Fire Hydrant Exhibit.dwg

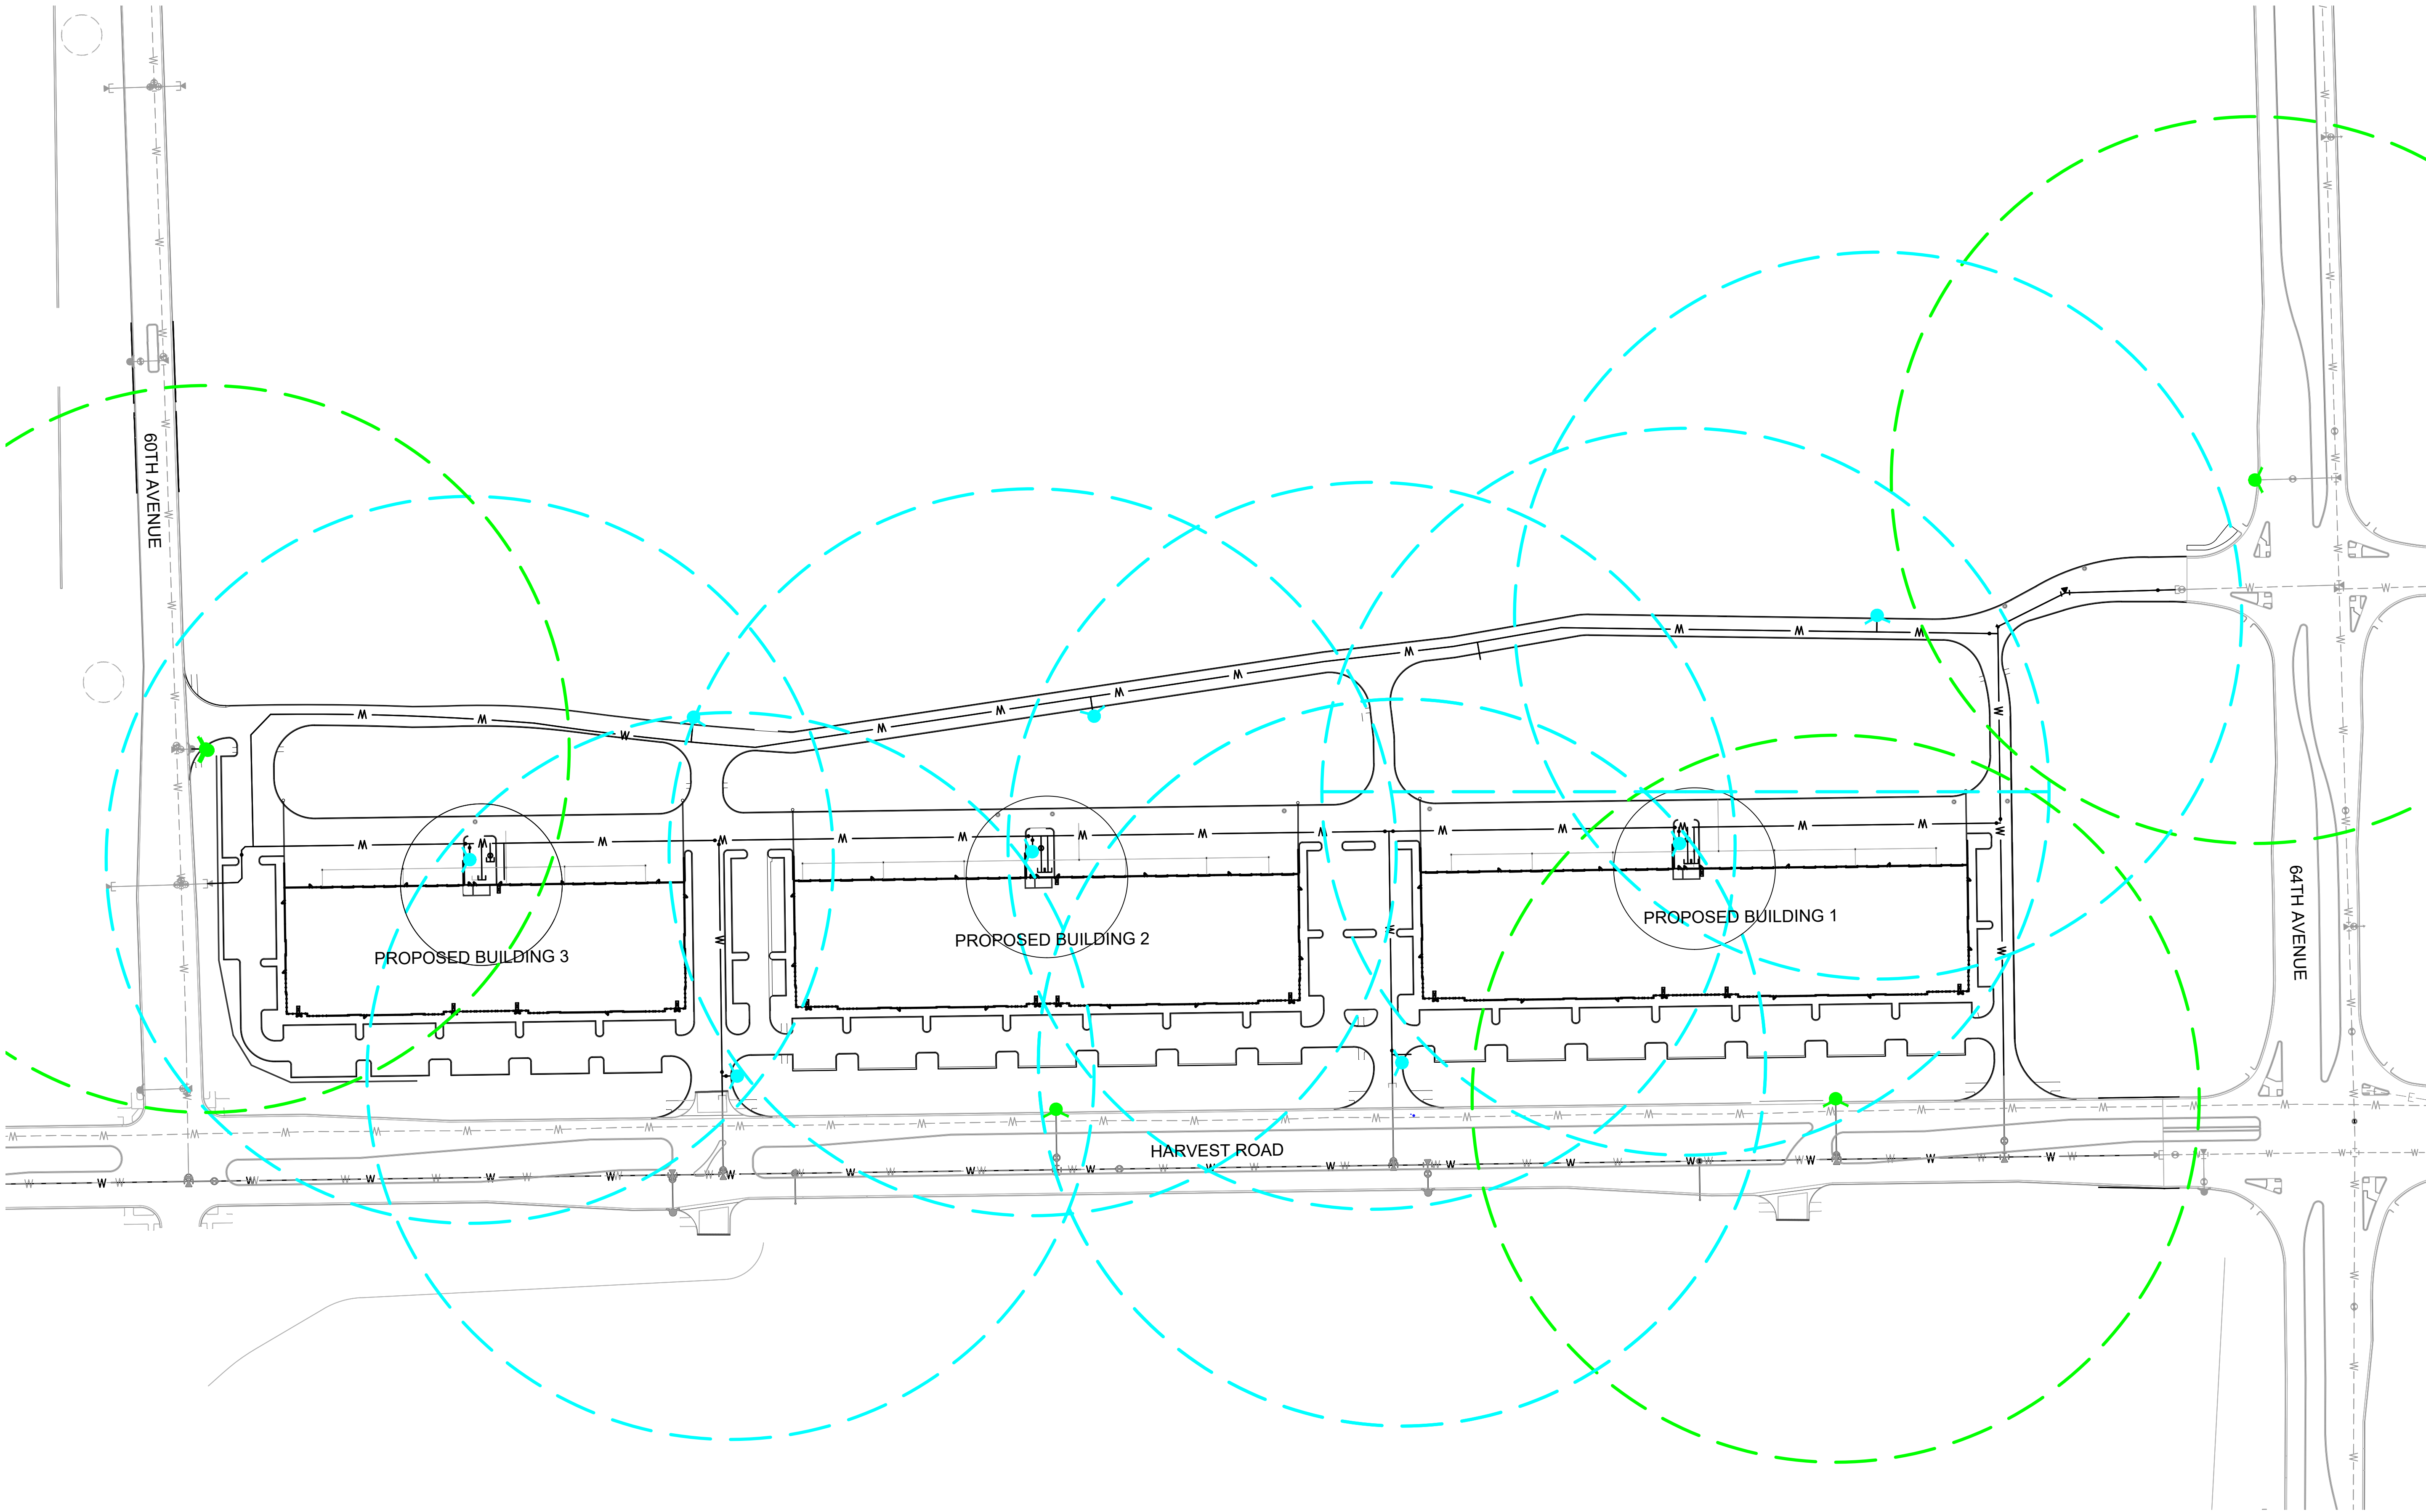

LEGEND:

- EXISTING FIRE HYDRANT RADIUS (450') ---
- PROPOSED FIRE HYDRANT RADIUS (450') ---

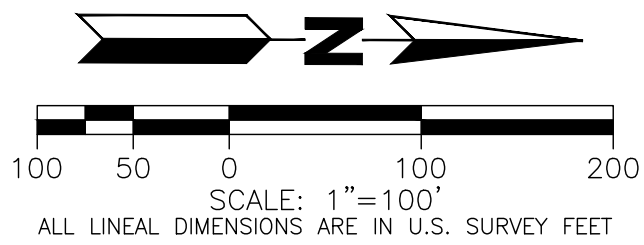

PA9 DEVELOPMENT


FIRE HYDRANT EXHIBIT
OVERALL

No.	Description of Revisions	Date	Name
1	EXHIBIT	10/24/23	MM

Job Number 22.1447
Project Manager DML
Design By BAM
Drawn By TJS
Principal in Charge DML

THE DESIGN SHOWN HEREIN INCLUDES ALL TECHNICAL DRAWINGS, SPECIFICATIONS, AND NOTES. IT IS THE USER'S RESPONSIBILITY TO VERIFY THE ACCURACY OF THE INFORMATION EXTRACTED FROM THIS SHEET AND TO OBTAIN NECESSARY PERMITS AND APPROVALS. THE USER ASSUMES ALL RISK OF THE USER AND NOT MARTIN/MARTIN, INC.

BUILDING	108,160 SQUARE FEET (TYPE IB) 3,500 GPM W/ 25% REDUCTION (PER TABLE B105.2 IFC – FULLY SPRINKLED) 2,625 GPM = 3 FIRE HYDRANTS
----------	---

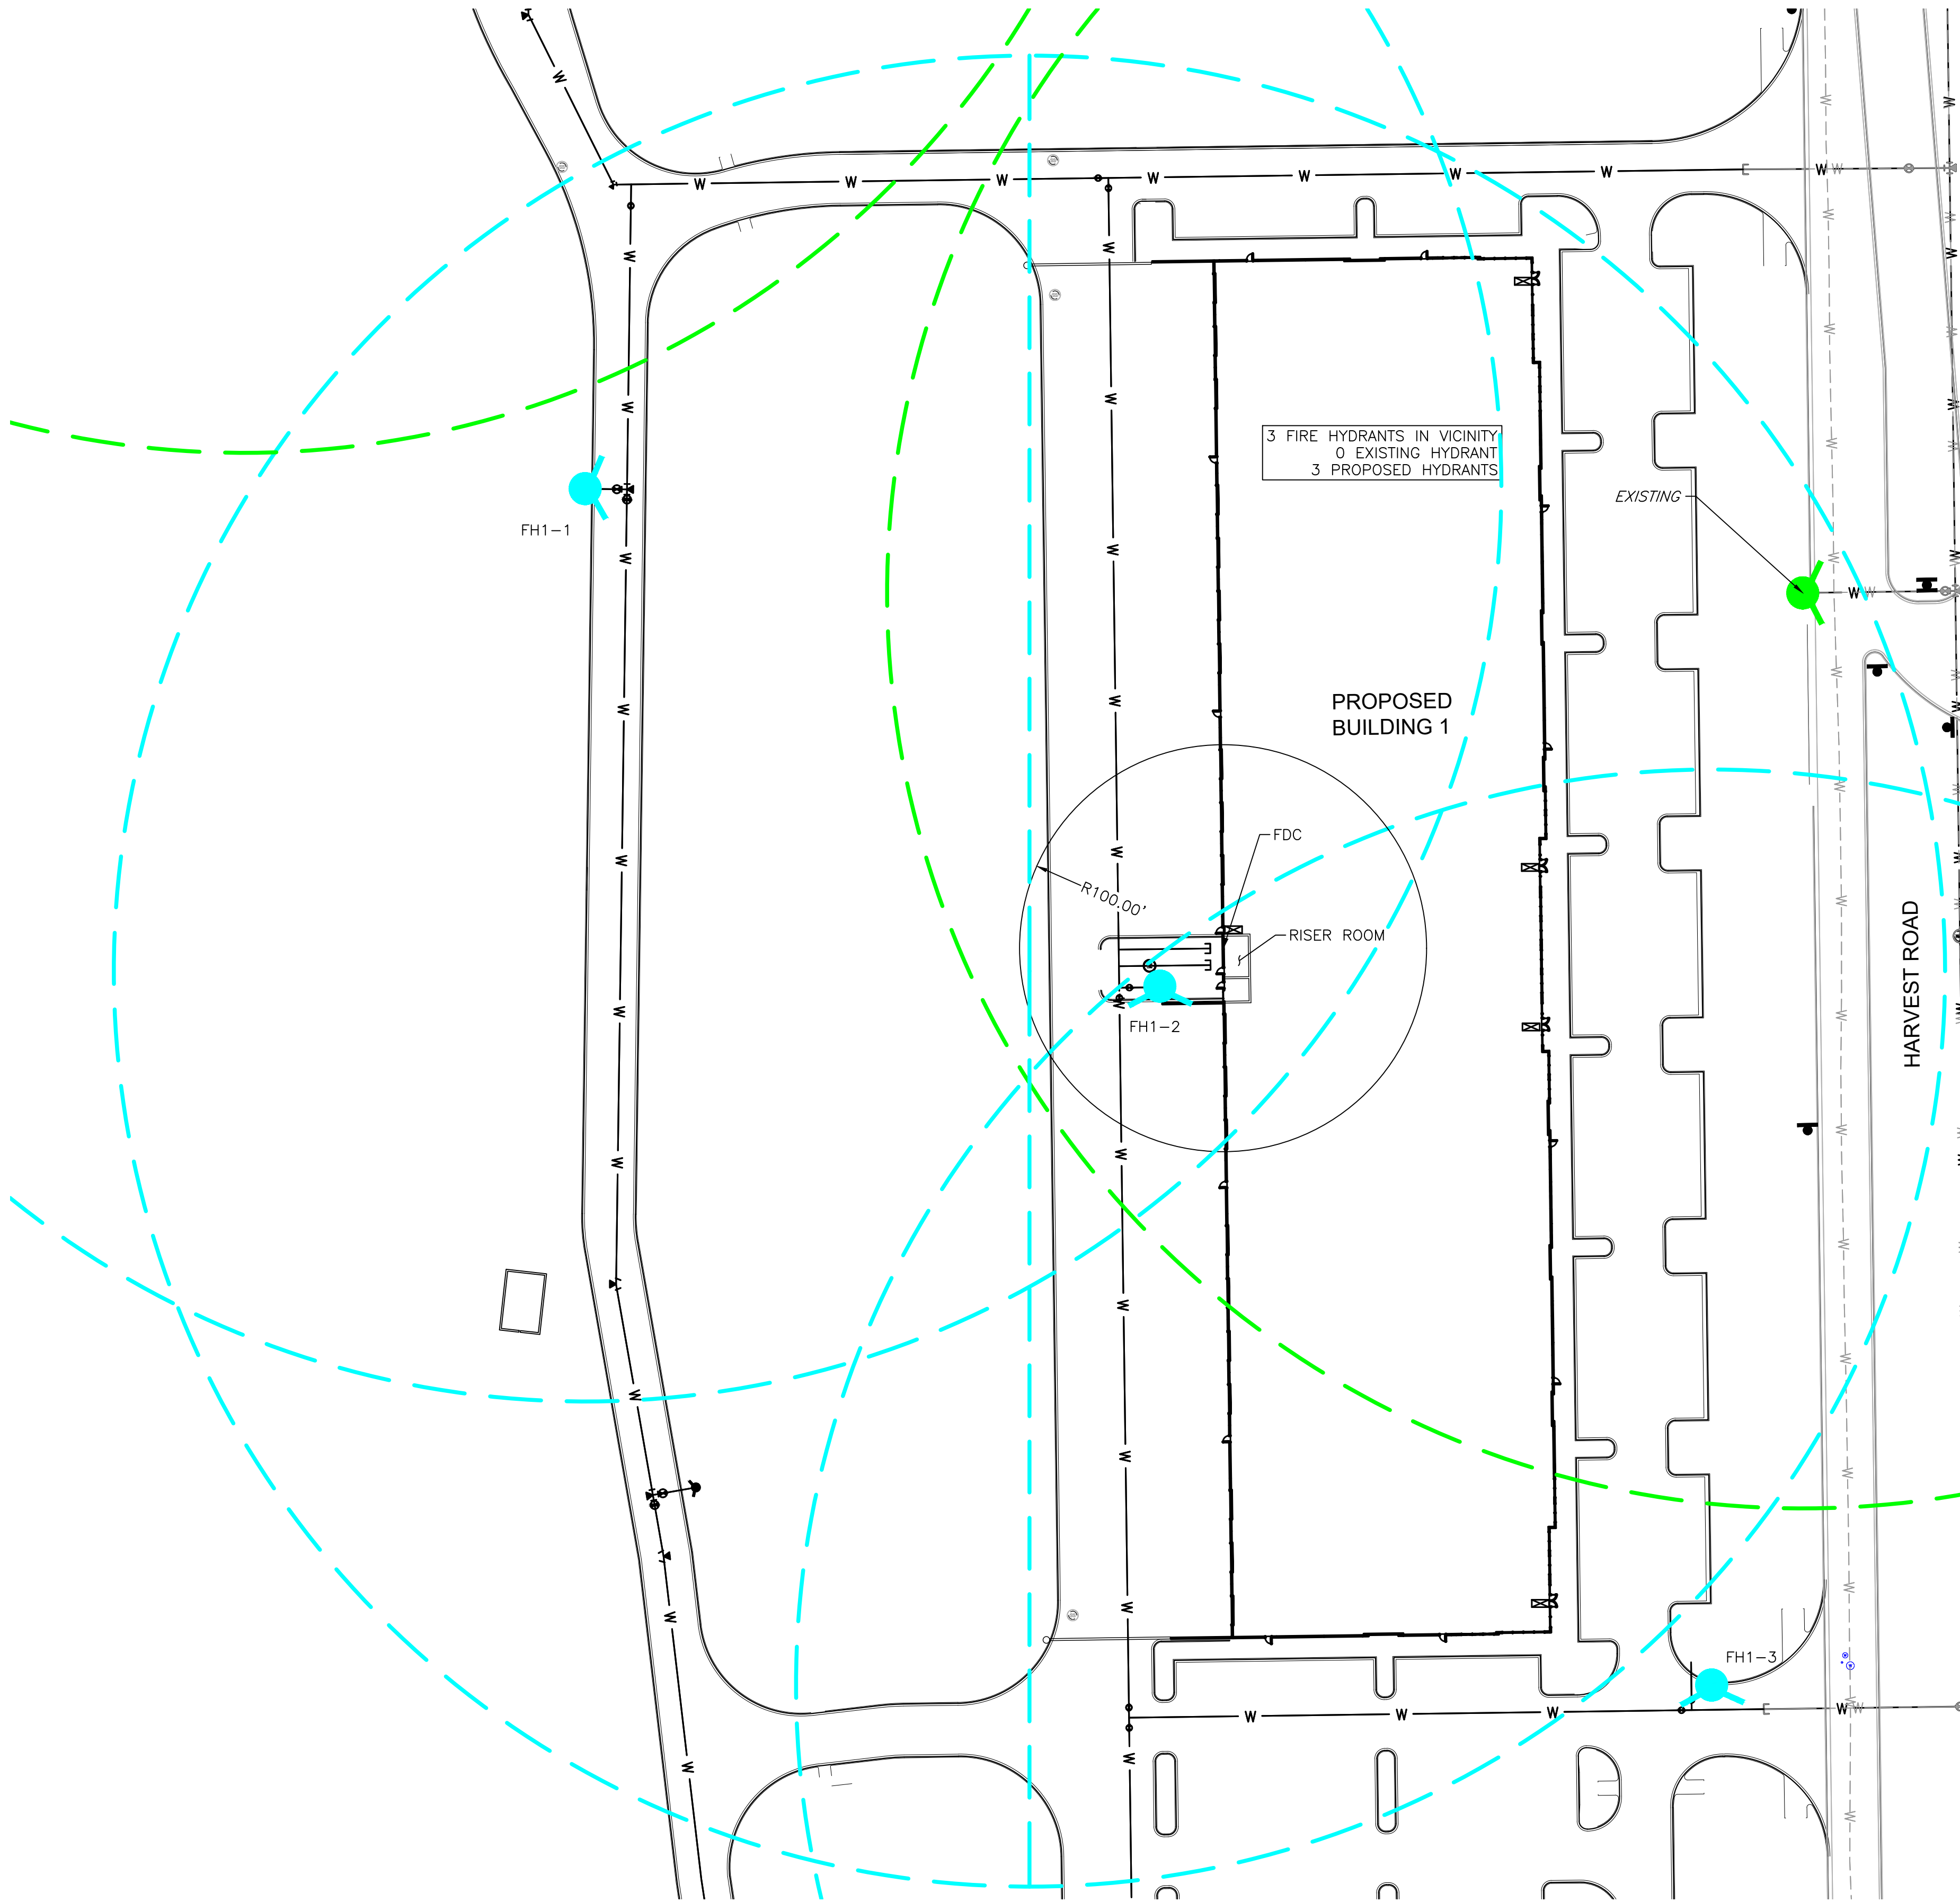


NOTES:

1. RADIUS OF 450 FEET BASED ON SECTION 16.06 OF CITY OF AURORA WATER, SANITARY SEWER & STORM DRAINAGE INFRASTRUCTURE STANDARDS & SPECIFICATIONS 2023.
2. HYDRANT REQUIREMENT BASED ON 2021 IFC AND 108160 SF TYPE IB CONSTRUCTION THAT HAS AUTOMATIC SPRINKLER

LEGEND:

EXISTING 450' FIRE HYDRANT RADIUS

PROPOSED 450' FIRE HYDRANT RADIUS

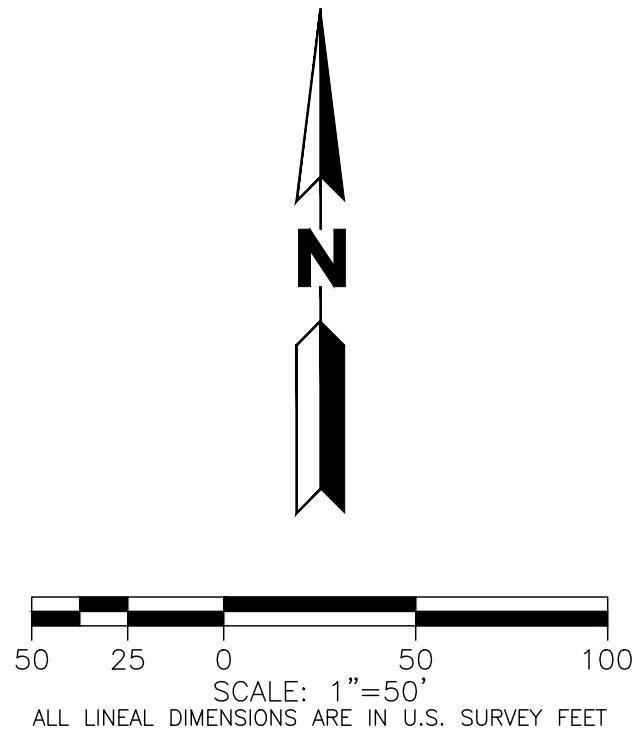

PA9 DEVELOPMENT

FIRE HYDRANT EXHIBIT


BUILDING 1

No.	Description of Revisions	Date	Name
1	EXHIBIT	10/24/23	MM

Job Number 22.1447	Project Manager DML
	Design By BAM
	Drawn By TJS
	Principal in Charge DML


THIS DRAWING IS A PRELIMINARY DESIGN. IT IS NOT TO BE USED FOR CONSTRUCTION. ANY INFORMATION EXTRACTED FROM THIS SHEET IS FOR INFORMATIONAL PURPOSES ONLY. THE USER ASSUMES ALL RISK OF THE USER AND NOT MARTIN/MARTIN, INC.

Sheet Number:

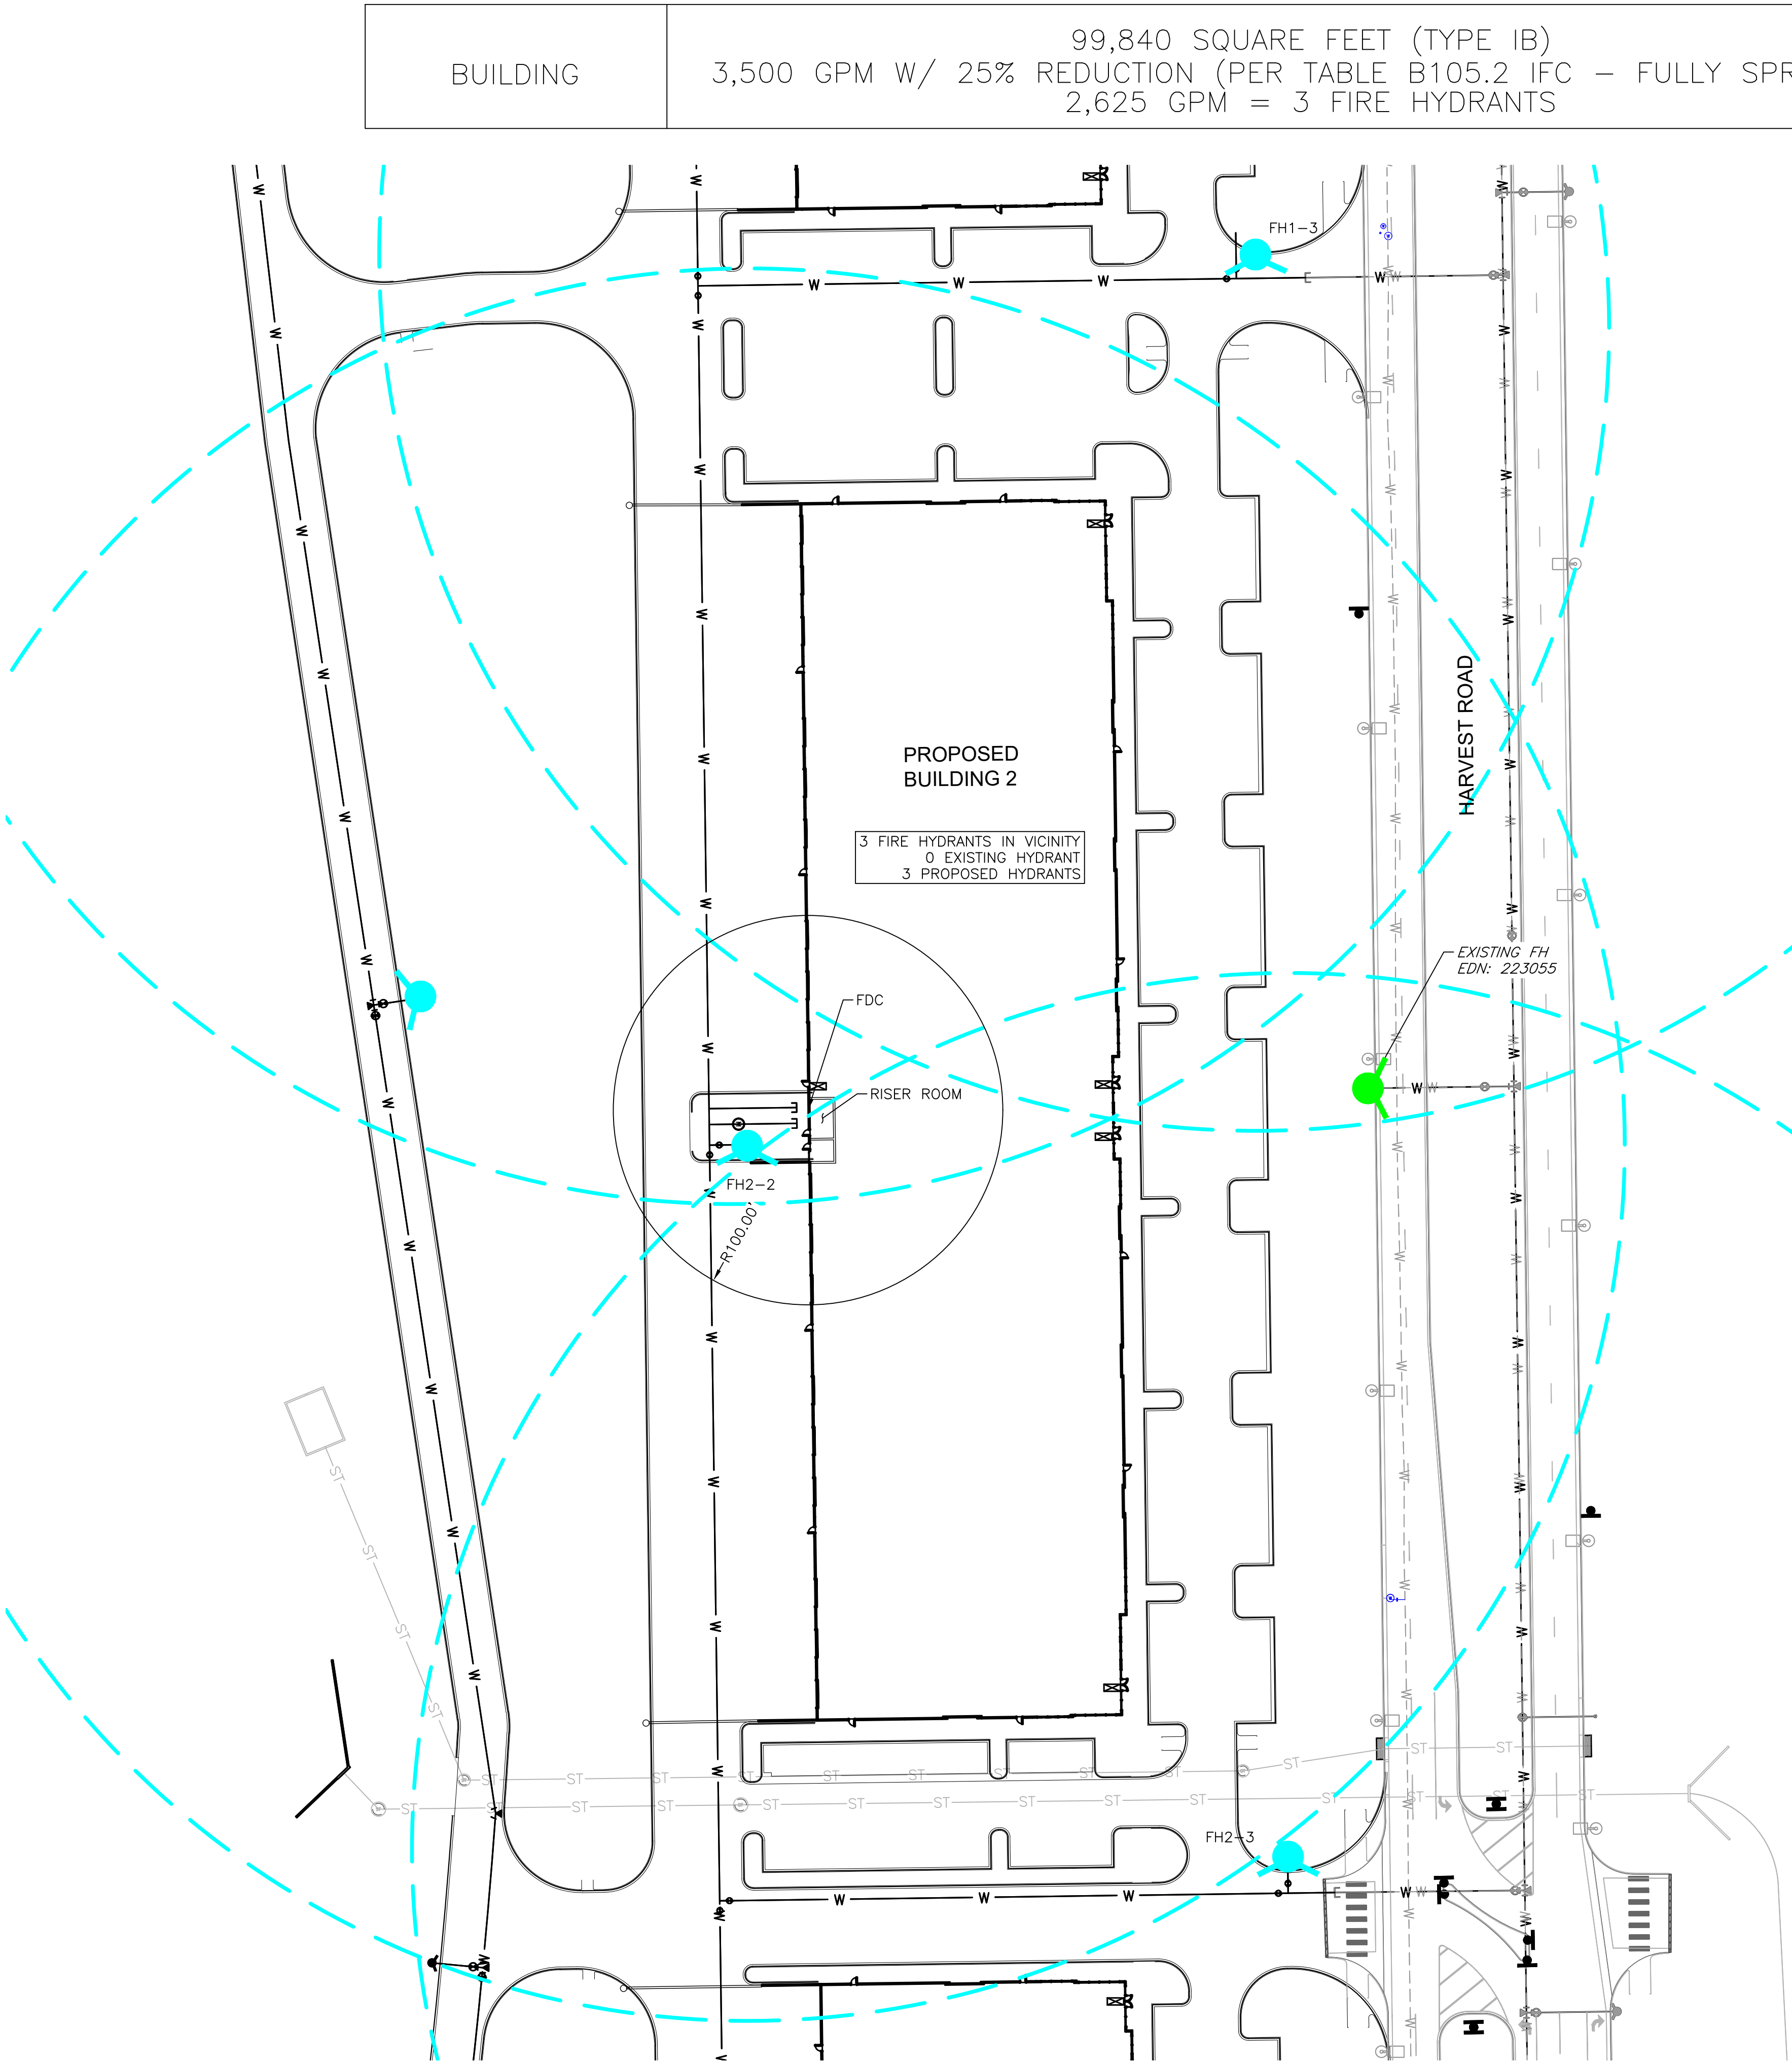

- NOTES:
1. RADIUS OF 450 FEET BASED ON SECTION 16.06 OF CITY OF AURORA WATER, SANITARY SEWER & STORM DRAINAGE INFRASTRUCTURE STANDARDS & SPECIFICATIONS 2023.
 2. HYDRANT REQUIREMENT BASED ON 2021 IFC AND 99840 SF TYPE IB CONSTRUCTION THAT HAS AUTOMATIC SPRINKLER

- LEGEND:
- EXISTING 450' FIRE HYDRANT RADIUS
- PROPOSED 450' FIRE HYDRANT RADIUS

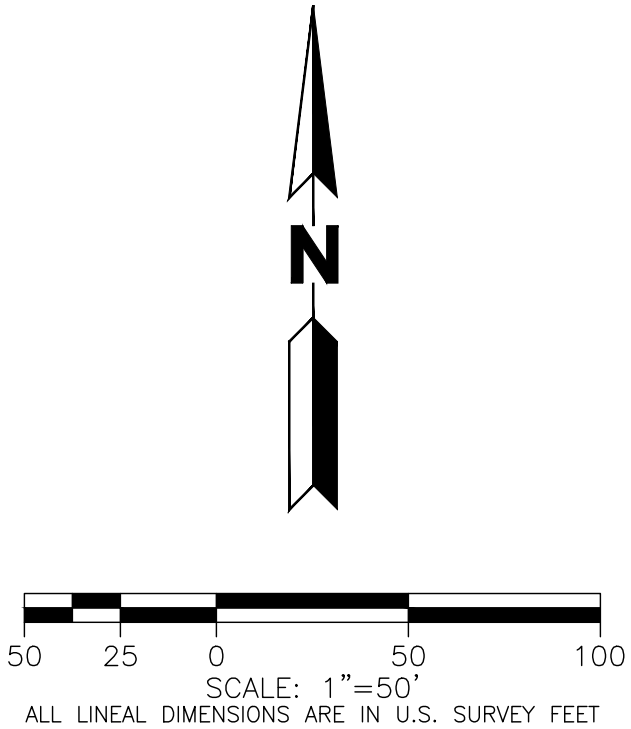

PA9 DEVELOPMENT

FIRE HYDRANT EXHIBIT
BUILDING 2


No.	Description of Revisions	Date	Name
1	EXHIBIT	10/24/23	MM

Job Number 22.1447	Project Manager DML
	Design By BAM
	Drawn By TJS
	Principal in Charge DML

THIS DOCUMENT, HEREIN, IS THE PROPERTY OF MARTIN/MARTIN CONSULTING ENGINEERS. IT IS TO BE USED ONLY FOR THE PROJECT AND SITE SPECIFIC INFORMATION EXTRACTED FROM THIS SHEET AND NOT FOR ANY OTHER PROJECT OR SITE. THE USER ASSUMES ALL LIABILITY AND RISK OF THE USER AND NOT MARTIN/MARTIN, INC.

Sheet Number:

PLOT DATE: Wednesday, October 25, 2023 1:04 PM LAST SAVED BY: DLE
DRAWING LOCATION: G:\LE\22.1447-Futenwider PA9 Development\PLANS\EXHIBITS\Fire Hydrant Exhibit.dwg

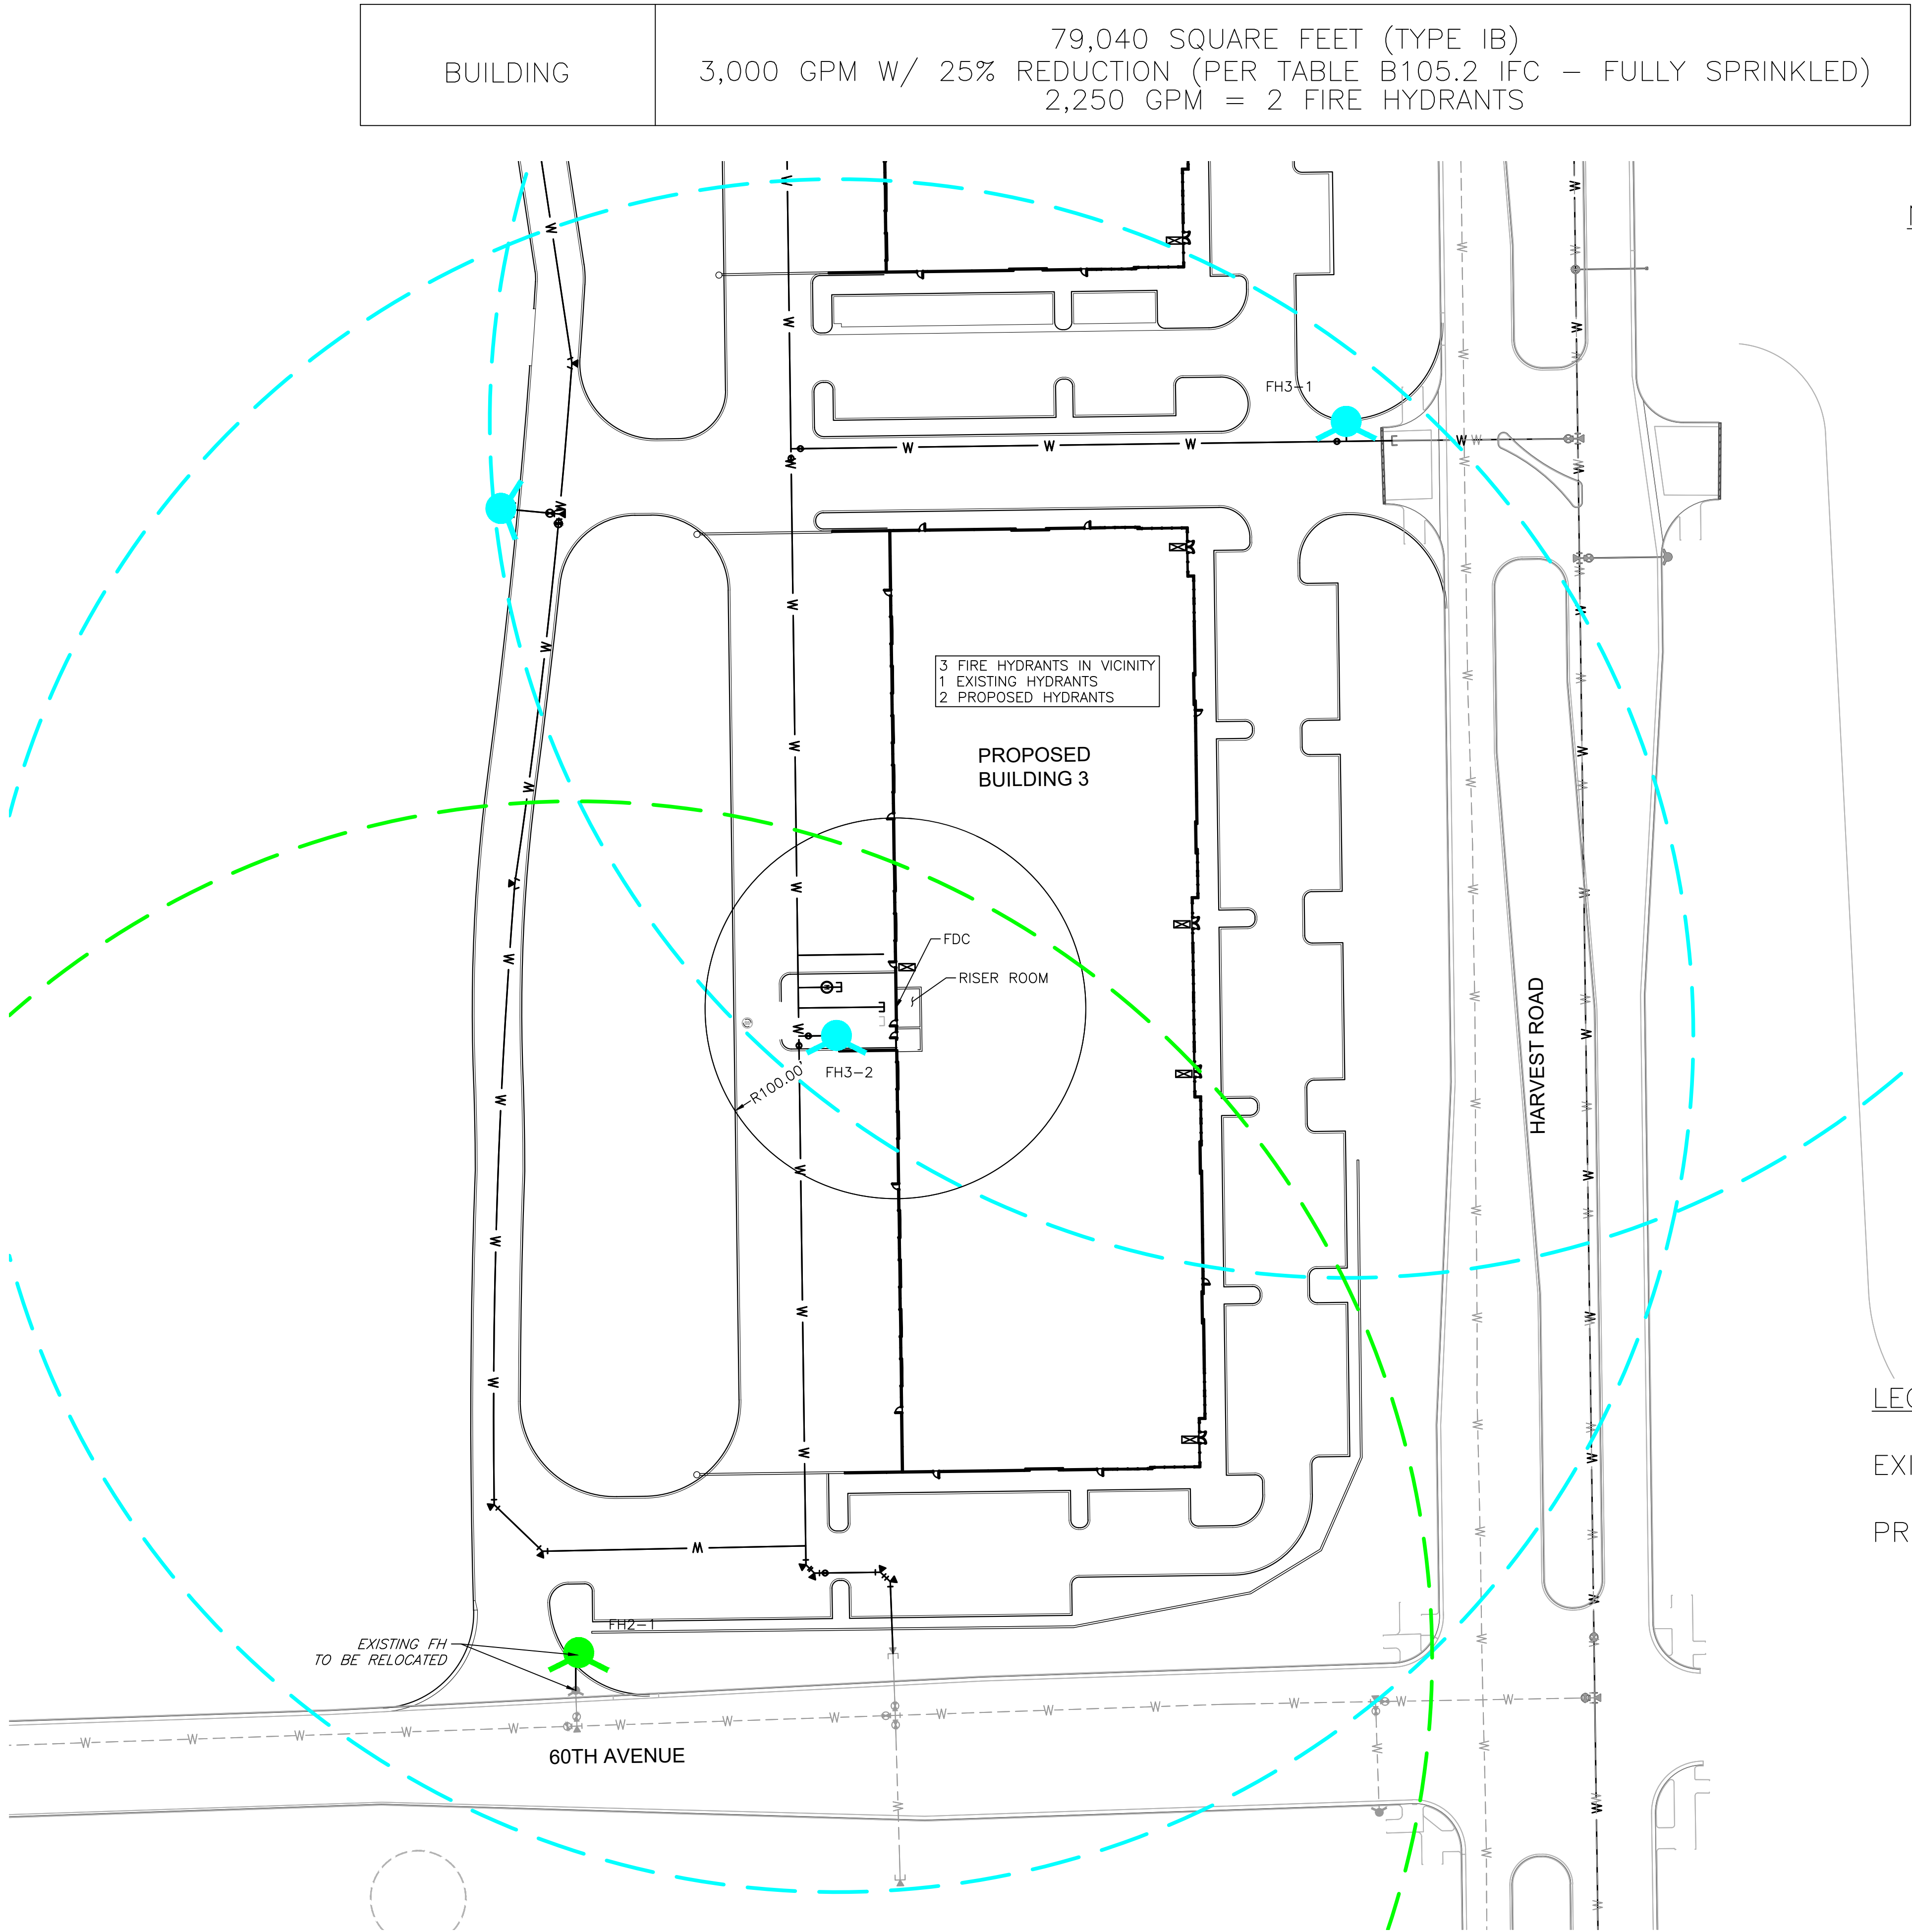


NOTES:

1. RADIUS OF 450 FEET BASED ON SECTION 16.06 OF CITY OF AURORA WATER, SANITARY SEWER & STORM DRAINAGE INFRASTRUCTURE STANDARDS & SPECIFICATIONS 2023.
2. HYDRANT REQUIREMENT BASED ON 2021 IFC AND 79040 SF TYPE IB CONSTRUCTION THAT HAS AUTOMATIC SPRINKLER

LEGEND:

EXISTING 450' FIRE HYDRANT RADIUS

PROPOSED 450' FIRE HYDRANT RADIUS

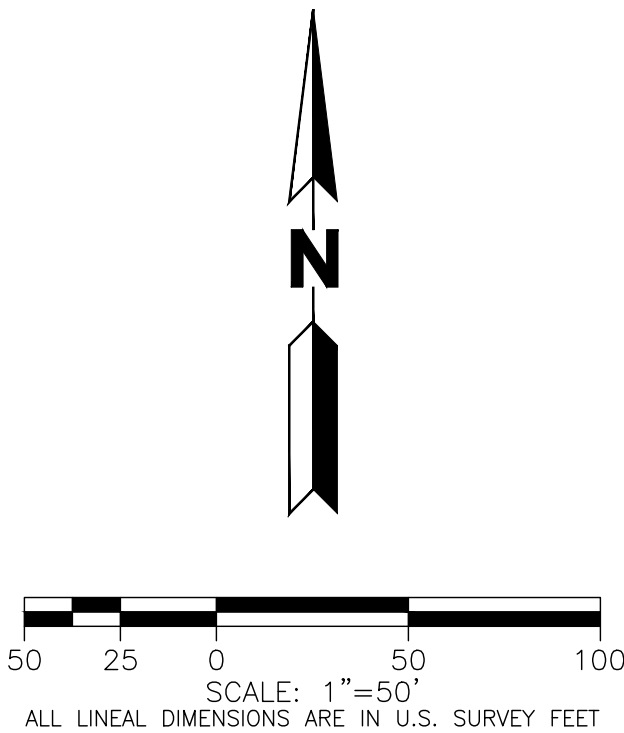

PA9 DEVELOPMENT

FIRE HYDRANT EXHIBIT

BUILDING 3

No.	Description of Revisions	Date	Name
1	EXHIBIT	10/24/23	MM

Job Number 22.1447	Project Manager DML
Design By BAM	Drawn By TJS
Principal in Charge DML	

THIS DRAWING IS A PRELIMINARY DESIGN. IT IS NOT TO BE USED FOR CONSTRUCTION. ANY INFORMATION EXTRACTED FROM THIS SHEET IS FOR INFORMATIONAL PURPOSES ONLY. THE USER ASSUMES ALL RISK OF THE USER AND NOT MARTIN/MARTIN, INC.

Sheet Number:

4

4 OF 4