

1 SITE PLAN – ELECTRICAL
SCALE: 1/4" = 1'-0"

- 1 CUSTOM ENCLOSURE ON CONCRETE PAD. REFER TO ELECTRICAL RISER.
- 2 NEW ELECTRICAL METER & PANEL. REFER TO SCHEDULE & RISER.
- 3 INSTALL PARKING LOT SURVEILLANCE AS PER LOCAL CITY ORDINANCE FOR PARKING LOT SECURITY. INSTALL NEW 20 AMP CIRCUIT FOR CAMERA COMMUNICATIONS. INSTALL ALL CAMERA CONTROLLERS & CONDUIT AS REQUIRED PER CITY ORDINANCE. MOUNT CAMERA & JUNCTION BOX WITH CABLE & CONDUIT. ROUTE TO COMMUNICATION BOX/ TERMINATION POINT AS PER CITY ORDINANCE. VERIFY WITH OWNER PRIOR TO BUILDING INSTALLATION.
- 4 MOUNT POLE ON 24" CONCRETE BASE AS PER DETAIL.
- 5 ROUTE CIRCUIT THROUGH CONTACTOR/TIMECLOCK AS PER SCHEDULE.
- 6 REFER TO ELECTRICAL RISER FOR CONTINUATION. FIELD VERIFY ROUTING LOCATION, ROUTE BELOW GROUND.

2 KEYED NOTES – PLAN

NOTE:

1. ELECTRICAL CONTRACTOR SHALL PROVIDE ALL STRUCTURAL SUPPORTS, BRACING AND UNISTRUT (NOT DIPPED GALVANIZED) NECESSARY TO ATTACH PANELS, METERS, WEATHERHEAD AND EQUIPMENT TO BUILDING WALL. ALL SUCH STRUCTURAL SHALL BE LOCATED AS REQUIRED ON BUILDING.
2. ALL ELECTRICAL EQUIPMENT CABINETS TO HAVE SAFETY EARTH ELECTRODE SYSTEM GROUND WITH 2AL-CU RATED CLAMPS OR CROWLEDED CONNECTIONS. ALL ELECTRICAL EQUIPMENT CABINETS TO BE GROUNDED TOGETHER.
3. ELECTRICAL CONTRACTOR SHALL PAINT ALL STRUCTURAL SUPPORTS, BRACING AND UNISTRUT AND ALL ELECTRICAL DEVICES PANELS, METERS, WEATHERHEAD AND EQUIPMENT COLOR TO MATCH BUILDING COLOR. VERIFY WITH ARCHITECT.
4. ELECTRICAL CONTRACTOR COORDINATE ROUTING OF ELECTRICAL SERVICE WITH LOCAL POWER COMPANY PRIOR TO CONSTRUCTION.
5. CONTRACTOR SHALL USE FACTORY-PROVIDED ITEMS WHEREVER POSSIBLE. FABRICATED ITEMS SHALL NOT BE USED UNLESS APPROVED PRIOR TO INSTALLATION BY THE ENGINEER/ARCHITECT.


ELECTRICAL CONTRACTOR:
COORDINATE ROUTING OF ELECTRICAL SERVICE WITH LOCAL LIGHTING & POWER PRIOR TO CONSTRUCTION.

ELECTRICAL MATERIAL AND EQUIPMENT NO ELECTRICAL MATERIALS, APPARATUS, DEVICES, APPLIANCES, FIXTURES, OR EQUIPMENT SHALL BE SOLD OR INSTALLED IN THE CITY UNLESS THEY ARE IN CONFORMANCE WITH THE PROVISIONS OF THIS CODE, THE LAWS OF THE STATE OF TEXAS AND ANY APPLICABLE RULES AND REGULATIONS ISSUED UNDER THE AUTHORITY OF THE STATE STATUTES, THE MAKER'S NAME, TRADEMARK, OR OTHER IDENTIFICATION SYMBOL SHALL BE PLACED ON ALL ELECTRICAL MATERIALS, APPARATUS, DEVICES, APPLIANCES, FIXTURES, AND EQUIPMENT USED OR INSTALLED UNDER THE PROVISIONS OF THIS CODE. ALL ELECTRICAL MATERIALS AND EQUIPMENT SHALL BE LISTED AND LABELED FOR THE INTENDED USE AND SHALL BE INCLUDED IN A LIST PUBLISHED BY AN APPROVED AGENCY. SECTION 508 CITY OF HOUSTON ELECTRICAL CODE.

| LUMINAIRE SCHEDULE | | | | | |
|---|--------------------------------|-----|---|---|---------------|
| Symbol | Label | Qty | Catalog Number | Description | VOLTAGE Watts |
| | OA | 2 | LSBW SERIES SABER LED AREA LIGHT. 120V | SINGLE HEAD LED AREA LIGHT MOUNTED ON 25" SQUARE, NON-TAPERED STEEL POLE. | 120V 300W |
| | OB | 1 | LSBW SERIES SABER LED AREA LIGHT. 120V | DUAL HEAD LED AREA LIGHT MOUNTED ON 25" SQUARE, NON-TAPERED STEEL POLE. | 120V 600W |
| | CANOPY LIGHT NOT SHOWN ON PLAN | 3 | LPC SERIES LED PETROLEUM CANOPY LIGHT. 120V | 12.75"x12.75" SQUARE LED FIXTURE. | 120V 1.05 AMP |
| STRUCTURAL TO WITHSTAND 110 MPH GUSTS OF WIND, AS PER LATEST INTERNATIONAL BUILDING CODE REQUIREMENTS. THIS IS NOT A STRUCTURAL ENGINEER DRAWINGS REFER TO ARCHITECTURAL / STRUCTURAL | | | | | |

3 LIGHT FIXTURE SCHEDULE

- 1 NEW SERVICE FEEDER & CONDUIT BELOW GRADE. 120/208 VOLT, 1ph, 3wire. 3 #4 AWG IN 2" CONDUIT.
- 2 NEW CUSTOM ORDERED WEATHER RESISTANT LOCKABLE ENCLOSURE MOUNTED ON CONCRETE PAD.
- 3 NEW 100 AMP METER AS PER LOCAL POWER COMPANY SERVICE STANDARDS.
- 4 NEW ELECTRICAL PANEL. NEMA 3R. RE: PANEL SCHEDULE.
- 5 ROUTE NEW CONDUITS FOR BRANCH CIRCUITS BELOW GRADE. RE: PLAN
- 6 NEW OPTOVA 750 ADVANCED FUNCTION DRIVE-UP ATM.
- 7 EXISTING 120/208 VOLT 1ph SERVICE @ ADJACENT POWER POLE. VERIFY LOCATION. ROUTE FEEDERS AND CONDUIT UP EXISTING POLES.
- 8 #6 GROUND BOND AS PER DETAIL.

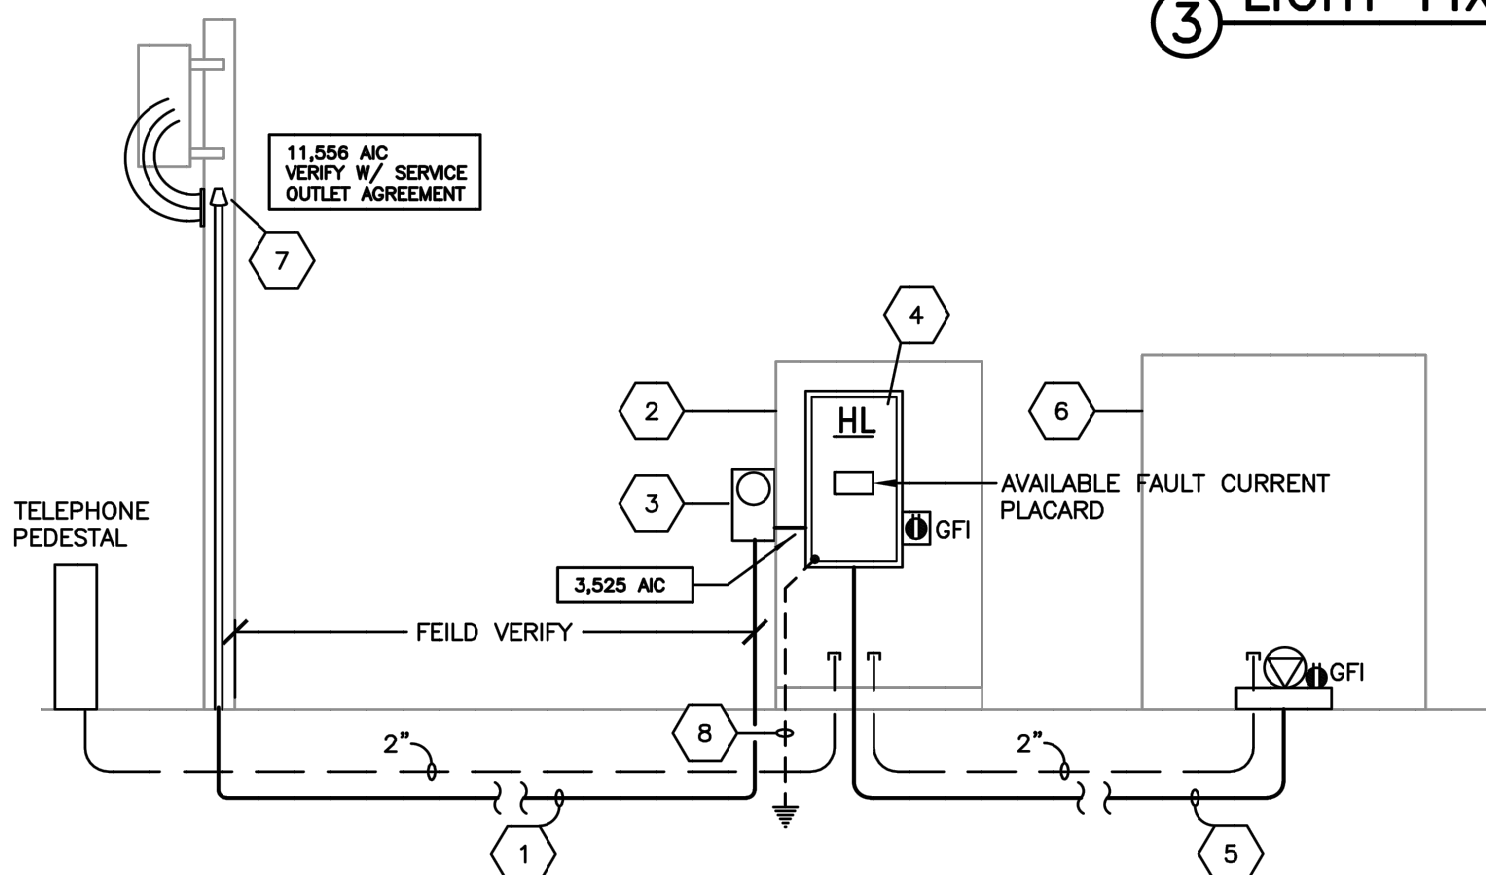


4 KEYED NOTES – ELECTRICAL RISER

5 SITE ELECTRICAL RISER

2"x3" PLACARD WITH BLUE LETTERING ON A CONTRASTING BACKGROUND PLACE ON PANEL WITH CORRECT INFORMATION

| AVAILABLE FAULT CURRENT FOR: | |
|------------------------------|------------------|
| DATE CALCULATED | 08/14/2017 |
| FAULT CURRENT TANS./WW | 11,556/3,525 AIC |
| TRANSFORMER SIZE | 50 KVA |

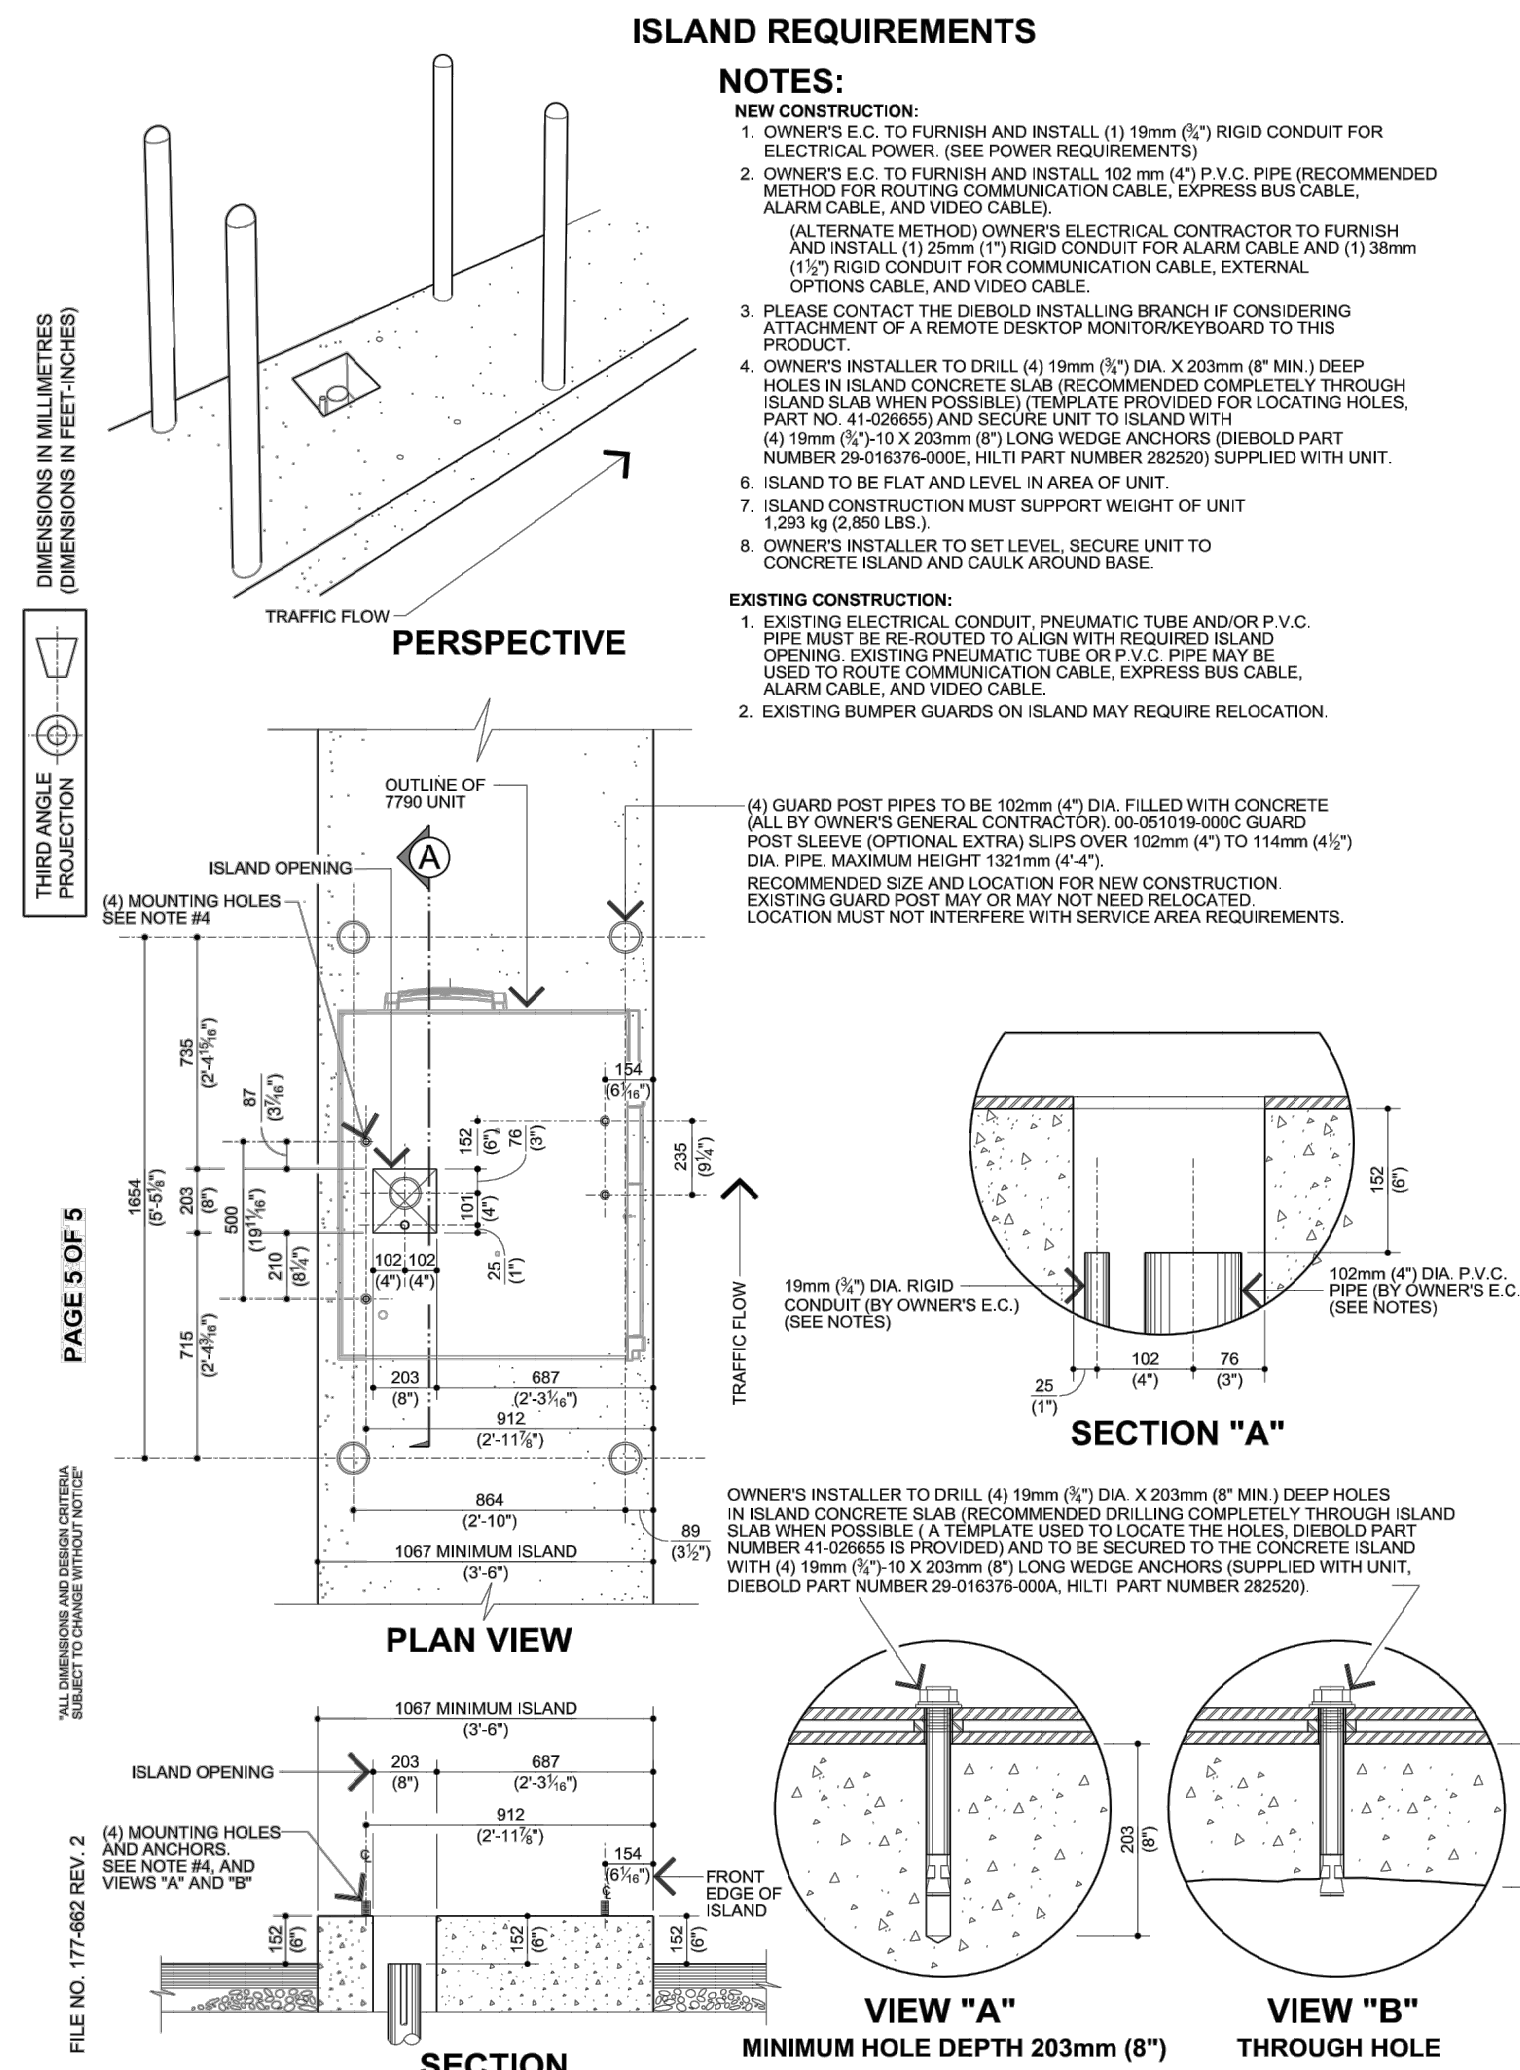

6 ELECTRICAL ATM PLAN DETAIL



1250 WOOD BRANCH PARK DR
STE 210
HOUSTON, TX 77079
(281) 293-7500
WWW.DVOENG.COM

FLITE BANKING CENTERS, LLC
WALMART #3566
9400 East Hampden Ave.
Denver, CO. 80231

| ISSUED FOR: | DATE | DESCRIPTION | PERMIT SET |
|-------------|----------|-------------|------------|
| REV. # | 08-24-17 | | |

DATE: 08/24/17 DVO JOB NO. 171199
PM: J.FEIT
DRAWN BY: JF CHECKED BY: JF
ISSUE: PERMIT
SCALE: AS NOTED

ELECTRICAL
SITE PLAN &
DETAILS

SE-1



Diagram illustrating the cross-section of a trench. The trench is defined by a top width of 1'-0" MIN. and a bottom width of 6" MIN. The trench depth is 2'-6" MIN. The trench is filled with material, and the top surface is labeled "NATURAL GRADE". The centerline of the trench is labeled "CL". A circular feature at the bottom center is labeled "CONDUIT REFER TO SPECIFICATIONS."

The diagram illustrates the grounding connections at a service entrance. A vertical line on the left represents the service drop. A horizontal line represents the service entrance conductors, with a ground (G) and neutral (N) conductor. A ground bar is connected to the ground conductor. A #6 AWG equip. bonding jumper connects the ground bar to the equipment. A #6 AWG main bonding jumper connects the ground bar to the main bonding point. A #6 Ufer copper 5/8" ground rod is connected to the ground bar. A continuous conductor is shown at the bottom, connected to the ground bar and the ground rod. A #6 ground bond to concrete encased electrode is also shown.

Prepared with Short-Circuit 2007 – Copyright Durand & Associates



Exterior Lighting Compliance Certificate

Project Information

Energy Code: 2015 IECC
Project Title: FLITE BANKING CENTERS, LLC - WALMART #3566
Project Type: New Construction
Exterior Lighting Zone: 4 (High activity metropolitan commercial district)

Construction Site:
9400 EAST HAMPDEN AVENUE
DENVER, CO 80231

Owner/Agent:

Designer/Contractor:
Dawson Van Orden Engineering
1250 Wood Branch Park Dr.
Suite 210
Houston, TX 77079
281-293-7500

Allowed Exterior Lighting Power

| A Area/Surface Category | B Quantity | C Allowed Watts / Unit | D Tradable Wattage | E Allowed Watts (B X C) |
|--|----------------------|------------------------------|--------------------------|-------------------------------|
| Drive-up ATM (ATM/Night depository location) (c) | 1 machines | 90 | No | 270 |
| ATM Drives (Outdoor sales area/lot) | 2000 ft ² | 0.7 | Yes | 1400 |
| Total Tradable Watts (a) = | | | | 1400 |
| Total Allowed Watts = | | | | 1670 |
| Total Allowed Supplemental Watts (b) = | | | | 1300 |

(a) Wattage tradeoffs are only allowed between tradable areas/surfaces.

(b) A supplemental allowance equal to 1300 watts may be applied toward compliance of both non-tradable and tradable areas/surfaces.

(c) ATM/Night depository sites have a base allowance of 180 W per site.

Proposed Exterior Lighting Power

| A Fixture ID : Description / Lamp / Wattage Per Lamp / Ballast | B Lamps/ Fixture | C # of Fixtures | D Fixture Watt. | E (C X D) |
|---|------------------------|-----------------------|-----------------------|--------------|
| <u>Drive-up ATM (ATM/Night depository location 1 machines): Non-tradable Wattage</u> | | | | |
| LED 1: OA: SINGLE LSBW LED: Other: | 1 | 2 | 300 | 600 |
| <u>ATM Drives (Outdoor sales area/lot 2000 ft²): Tradable Wattage</u> | | | | |
| LED 2: OB: TWIN LSBW LED: Other: | 1 | 1 | 600 | 600 |
| LED 3: Canopy LED Light: Other: | 1 | 3 | 126 | 378 |
| Total Tradable Proposed Watts = | | | | 978 |

Exterior Lighting PASSES: Design 59% better than code

Exterior Lighting Compliance Statement

Compliance Statement: The proposed exterior lighting design represented in this document is consistent with the building plans, specifications, and other calculations submitted with this permit application. The proposed exterior lighting systems have been designed to meet the 2015 IECC requirements in COMcheck Version 4.0.6.2 and to comply with any applicable mandatory requirements listed in the Inspection Checklist.

JASON W. DAWSON, P.E.
Name - Title

Signature

Date

9/13/17

Project Title: FLITE BANKING CENTERS, LLC - WALMART #3566
Data filename: O:\Houston\1 ALL PROJECTS Folder\2017\171199 Walmart - Parking ATM\MEP\ENERGY FORM\171199 - Walmart #3566 Parking ATM.cck

Report date: 09/12/17

Page 2 of 6



Inspection Checklist

Energy Code: 2015 IECC

Requirements: 0.0% were addressed directly in the COMcheck software

Text in the "Comments/Assumptions" column is provided by the user in the COMcheck Requirements screen. For each requirement, the user certifies that a code requirement will be met and how that is documented, or that an exception is being claimed. Where compliance is itemized in a separate table, a reference to that table is provided.

| Section # & Req.ID | Plan Review | Complies? | Comments/Assumptions |
|---------------------------|---|--|----------------------|
| C103.2 [PR8] ¹ | Plans, specifications, and/or calculations provide all information with which compliance can be determined for the exterior lighting and electrical systems and equipment and document where exceptions to the standard are claimed. Information provided should include exterior lighting power calculations, wattage of bulbs and ballasts, transformers and control devices. | <input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable | |

Additional Comments/Assumptions:

| | | | | | |
|---|----------------------|---|------------------------|---|---------------------|
| 1 | High Impact (Tier 1) | 2 | Medium Impact (Tier 2) | 3 | Low Impact (Tier 3) |
|---|----------------------|---|------------------------|---|---------------------|

| Section # & Req.ID | Rough-In Electrical Inspection | Complies? | Comments/Assumptions |
|---------------------------------|---|--|----------------------|
| C405.2.5 [EL25] ^{null} | Automatic lighting controls for exterior lighting installed. Controls will be daylight controlled, set based on business operation time-of-day, or reduce connected lighting > 30%. | <input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable | |

Additional Comments/Assumptions:

| | | | | | |
|---|----------------------|---|------------------------|---|---------------------|
| 1 | High Impact (Tier 1) | 2 | Medium Impact (Tier 2) | 3 | Low Impact (Tier 3) |
|---|----------------------|---|------------------------|---|---------------------|

Project Title: FLITE BANKING CENTERS, LLC - WALMART #3566

Report date: 09/12/17

Data filename: O:\Houston\1 ALL PROJECTS Folder\2017\171199 Walmart - Parking ATM\MEP\ENERGY FORM\171199 - Walmart #3566 Parking ATM.cck

Page 4 of 6

| Section # & Req.ID | Final Inspection | Complies? | Comments/Assumptions |
|------------------------------|--|--|--|
| C405.5.1 [FI19] ¹ | Exterior lighting power is consistent with what is shown on the approved lighting plans, demonstrating proposed watts are less than or equal to allowed watts. | <input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable | See the Exterior Lighting fixture schedule for values. |

Additional Comments/Assumptions:

| | | | | | |
|---|----------------------|---|------------------------|---|---------------------|
| 1 | High Impact (Tier 1) | 2 | Medium Impact (Tier 2) | 3 | Low Impact (Tier 3) |
|---|----------------------|---|------------------------|---|---------------------|

Project Title: FLITE BANKING CENTERS, LLC - WALMART #3566

Report date: 09/12/17

Data filename: O:\Houston\1 ALL PROJECTS Folder\2017\171199 Walmart - Parking ATM\MEP\ENERGY FORM\171199 - Walmart #3566 Parking ATM.cck

Page 5 of 6

GENERAL NOTES:

- 1. Do Not Guess. Direct all Questions Concerning This Drawing to Elrod Engineering, LLC.(615-890-9405)
- 2. Do Not Scale This Drawing.
- 3. Graphics are not to be Reproduced From This Drawing.
- 4. Structural Steel Plate & Angle Shall Conform to ASTM A36 (Fy (Yield)= 36 ksi).
- 5. Steel Pipe Fabricated From Plate Shall Conform to ASTM A36 (Fy (YIELD)= 36 ksi min.).
- 6. Steel Pipe not Fabricated From Plate Shall Conform to ASTM A53 Type "E" or "S", Grade "B" or Equivalent. (Fy (Yield)= 35 ksi min.) Do Not Use Mill Reject Pipe. A53 Type "F" is NOT Permitted.
- 7. Structural Steel Tubing Shall Conform to ASTM A500 Grade "B" (Fy = 46 ksi).
- 8. Aluminum Structural Shapes Shall Conform to the Specifications from The Aluminum Association's Aluminum Design Manual 2010 for 6061-T6;
Square/Rectangular Tube & Round Pipe (Fy:35ksi Unwelded)
Plate and Angle (Fy:35ksi Unwelded)
All Structural Shapes (Welded Fy:15ksi ≤ 0.375" Thick, 11ksi > 0.375" Thick)
- 9. For welding aluminum, Use 5356 alloy electrodes for 6061 Base Metal.
- 10. "Legible" Mill Test Certificates, Expressed in "KSI" or "PSI", are Required on all Pipe. All Pipe to Conform to ASTM A36 or ASTM A53 Type "E" or "S", Grade "B". The Yield Stress Limits are in Place to Help Ensure the Sign Structure Performs to the Engineered Design. Used Pipe and Pipe for Which Mill will not Provide Certification will not be Allowed!
- 11. As Pipe Sections are not Perfectly Round, Careful Shop Fit-Up of the Splice Connections Shall be Performed. Line-up Markings are to be Provided to Avoid Costly Labor and Crane Charges.
- 12. Pipe Shall be Considered Ovalled and Unacceptable if the Measured Outside Diameter at any Point Varies by More Than 2% of the Nominal Outside Diameter as Specified on the Design Documents. Large Diameter Pipes Should be Braced to Help Prevent Distortion After Fabrication.
- 13. Pipe with Dimpled Walls, Ovalled Pipe and Bent Connection Elements Shall not be Used.
- 14. Breach Openings of any Size in the Wall of any Pipe Sections are Strictly Prohibited.
- 15. All Metal not Specified as Aluminum Shall be Steel.
- 16. All Welding Shall Conform to Recommendations as Published by The American Welding Society D1.1.
- 17. Workmen Who will Perform Welding Operations Shall be Certified for the Applicable Welding Procedure.
- 18. For welding steel, Use E70 Series Low Hydrogen Electrodes.
- 19. Fabricated Steel Shall be Cleaned of Mill Scale, Oil, & Other Surface Contaminates Prior to Painting.
- 20. All Steel, Pipe Sections(Exposed and Embedded), and Splice Connections Must be Primed, Painted and Allowed to Cure Prior to Shipping to Site.
- 21. Alteration to any Fabricated Part of the Structure by Use of a Cutting Torch or any Other Means is Prohibited Without the Consent of the Engineer.
- 22. The Base Section of Pipe Shall be "Plumb" Before Continuing with the Erection Procedure.
- 23. Any Holes Cut in Pipe for Handling Must be Completely Filled with Weld Material and Ground Smooth.
- 24. Cabinet Mounting Bolts to be ASTM A325. Bolts, Nuts, Flat & Lock Washers to be Zinc Plated or Hot-Dip Galvanized with Threads Excluded From the Shear Plane. Vendor Shall use a Method For Tightening Bolts Such That Proper Pre-load is Obtained as Specified by The American Institute of Steel Construction & The Industrial Fasteners Institute.

FOUNDATION NOTES:

- 1. Concrete shall be Ready Mixed; Designed to develop a minimum compressive strength as stated in foundation criteria below. Water is NOT to be added to concrete at job site.
- 2. Reinforcing steel shall conform to ASTM A615 Grade 60 w/Deformations conforming to ASTM A-305.
- 3. Excavation is to be in compliance with OSHA regulations and shall have a level bottom free of loose soil, water and debris.
- 4. Where Extreme Frost Depth is below bottom of foundation, excavate to 6 inches below frost depth and increase concrete quantity.
- 5. Bearing Surfaces for foundations should not be disturbed or left exposed during Inclement Weather. Saturation of the on-site soils can cause a loss of strength and increased compressibility. If construction occurs during inclement weather, and placement of the foundation is not possible at time excavated, a layer of lean concrete should be placed on the bearing surface for protection.
- 6. If rain is expected within 24 hours of completing the concrete pour, the concrete must be covered. If temperatures are expected to drop below 40 degrees within the next 24 hours of completing the concrete pour, then concrete is to be covered and protected to prevent heat loss and freezing.
- 7. The base of pipe section shall be "Plumb" and "Adequately Braced" to prevent movement before, during, and after concrete pour and left in place until concrete has set.
- 8. Reinforcing steel shall be free from mud, oil or other nonmetallic coatings that decrease bond.
- 9. Maintain a minimum of 3" clear distance from face of concrete to all reinforcing steel, unless otherwise noted on drawing.
- 10. Bottom reinforcement to be supported w/ concrete block solids no larger than 4"x4".
- 11. Do not weld reinforcing steel. Reinforcement shall be placed as detailed on the design drawings & "Tied" securely to prevent movement during concrete pour.
- 12. Concrete shall not be placed on frozen ground.
- 13. Do not cold joint concrete. Foundation must be poured continuously until all concrete has been placed. Concrete must be poured as a workable mixture with a Slump between 4"-6". All concrete mixing trucks must thoroughly and completely mix the concrete prior to pouring.
- 14. Additional water is not to be added to concrete on site. Additional water decreases the strength of the concrete mixture. Concrete should be rejected in lieu of changing concrete mixture on site.
- 15. Vendor should work the top of the concrete to ensure all rock has been covered by cement and top of concrete foundation is level. Top of concrete may be broom finished.
- 16. Anchors Shall be Securely Mounted Using an Anchor Setting Template to Avoid Movement During Concrete Pour. Extreme Caution Should be Exercised to Insure Orientation, Alignment, and Projection of Threads, and to Avoid Fouling Threads with Concrete During Pour.
- 17. Sign Contractor Shall Pack the Space Between the Base Plate and the Top of Concrete Solid with High Strength Non-Shrink Non-Metallic Grout. Do Not use Concrete Mix For Grout. Workmen Experienced in the Use of Non-Shrink Grout shall Perform Grouting.
- 18. Where Anchor Bolts are Required, Anchor Bolts Shall be Cut From Round Rod and Shall Conform to A.S.T.M. A36 Steel. Exposed Surfaces Shall be Hot-Dip Galvanized or Coated to Prevent Corrosion.
- 19. Note Overall Length of Anchors and Amount of Threading Required on each end of Anchor Rod Per Details on Each Drawing. Threading Shall be Carefully Controlled to Avoid Over-Cutting or Under-Cutting of Threads. Nut Shall Move Freely by Hand Without "Wobble".
- 20. Mechanical Vibrators Shall be Used to Consolidate Concrete Around Support and/or Reinforcement.
- 21. Concrete must be allowed to cure for 14 days prior to installing remaining stages of structure or sign cabinet(s).



| | |
|----------|--------------|
| Drawn | DBP |
| Checked | WML |
| EAC Job# | 100z2616 |
| Filename | 100x2616.dwg |
| Created | 9/19/2017 |



ELROD
ENGINEERING
871 Seven Oaks Blvd., Suite 220
Smyrna, TN 37167
800-553-5111

CLIENT:

Accent Sign & Awning
6015 Skyline Drive
Houston, TX 77057

| GENERAL NOTES |
|---|
| Comm. Banks of Colorado #3566 9490 E. Hampden Ave. Aurora, CO 80231 |


| Revisions |
|-----------|
| |
| |
| |
| |

Sheet No.

S-1


Sign Company to Use Experienced Excavation Crew to Perform Foundation Excavation.

Where Required, Place Electrical Conduit in Foundation Prior to Concrete Pour.

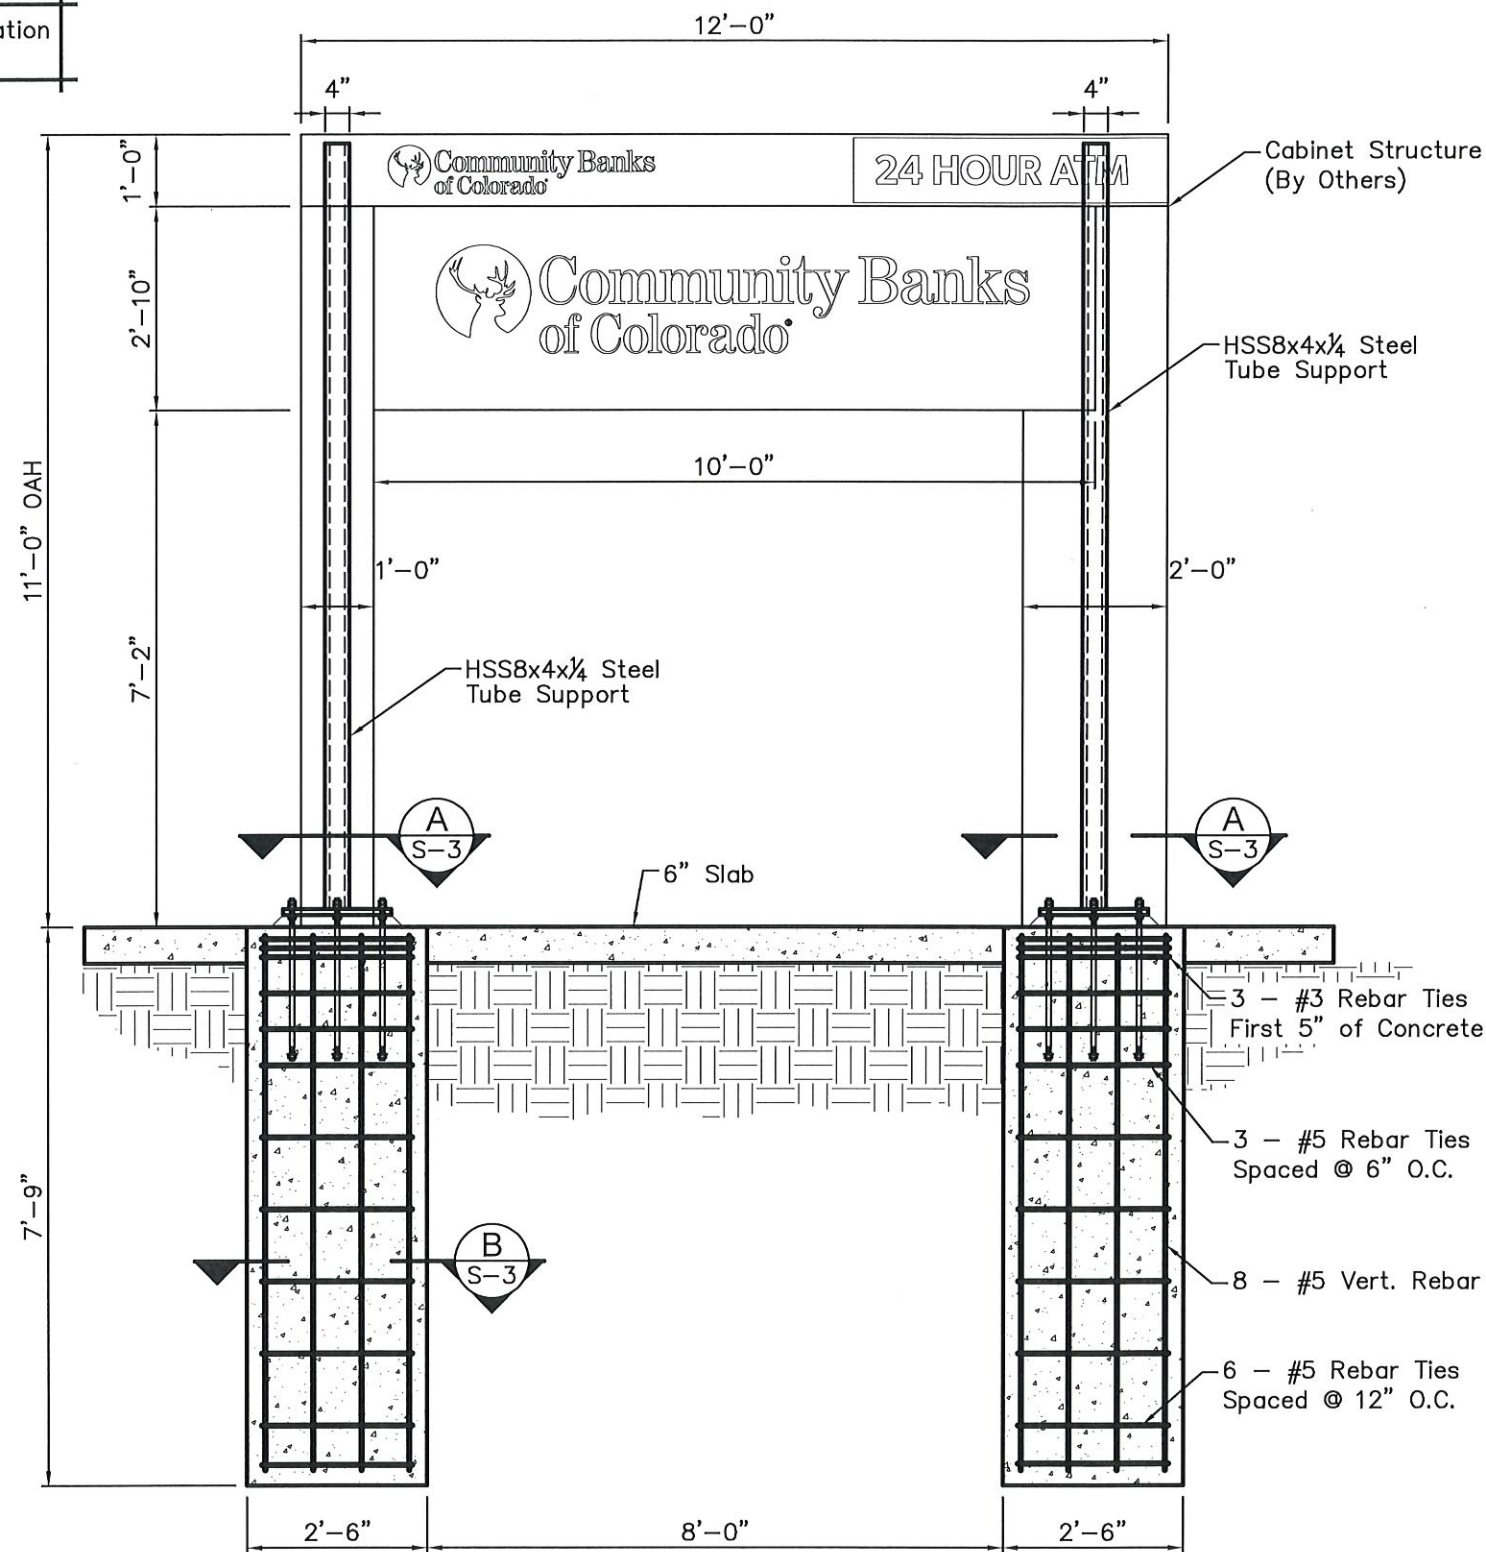

CANOPY STRUCTURE ELEVATION

SCALE: $\frac{3}{8}$ " = 1'-0"

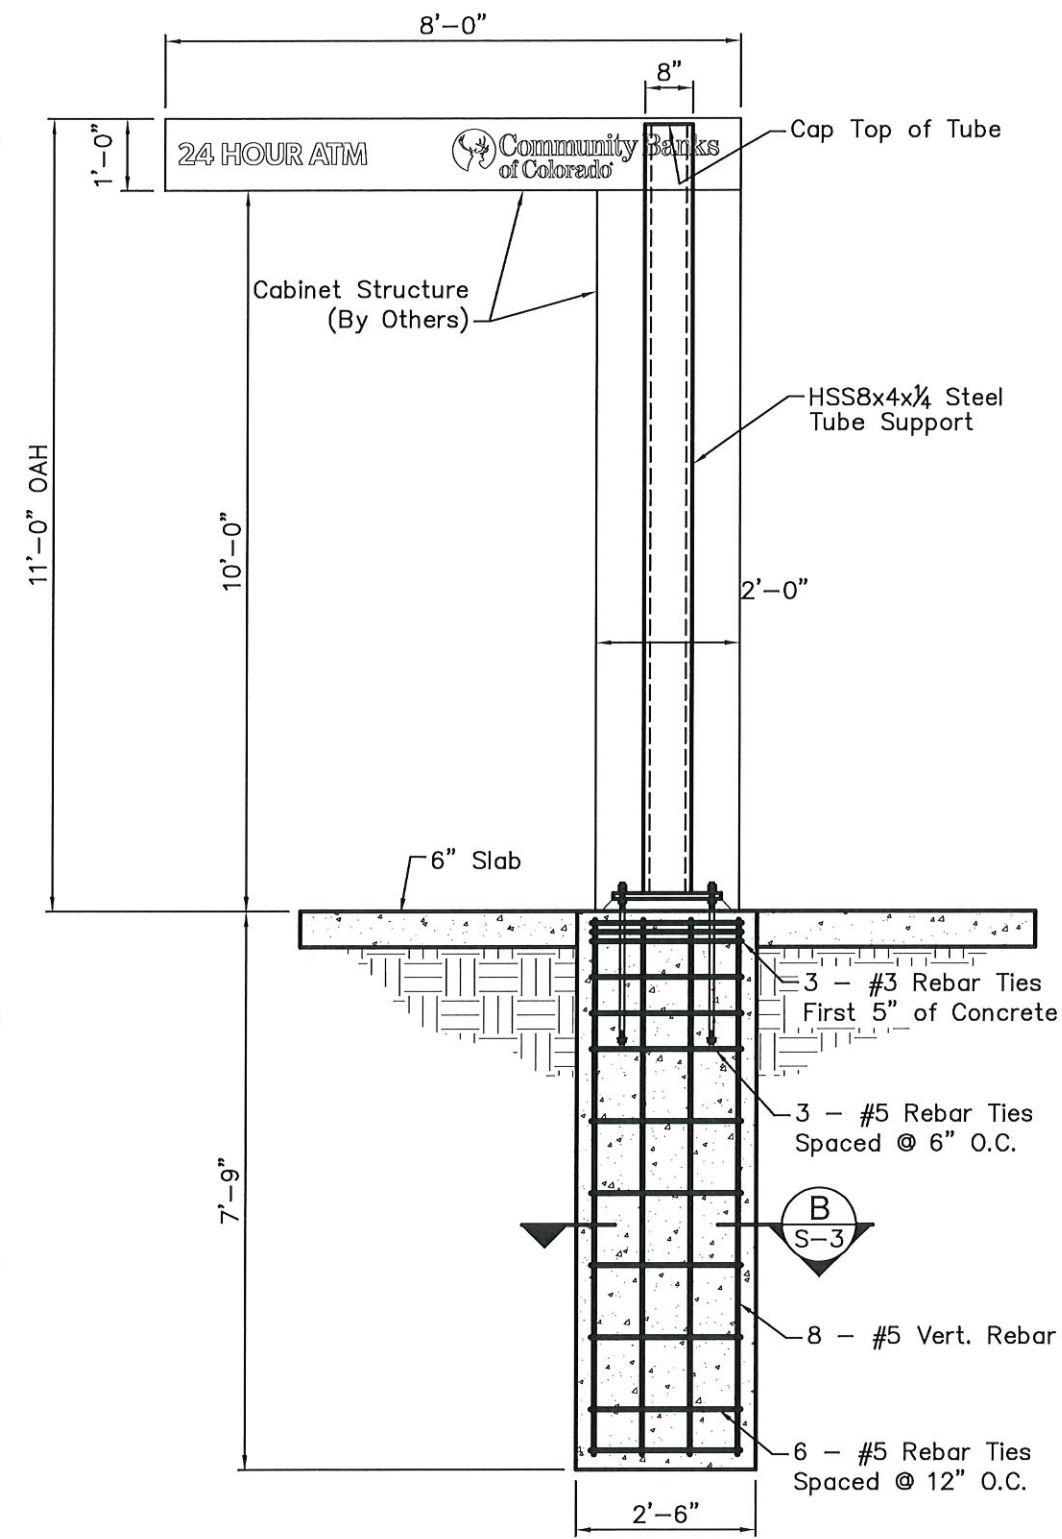

CANOPY STRUCTURE PROFILE

SCALE: $\frac{3}{8}$ " = 1'-0"

DESIGN CRITERIA

Building Code: IBC 2012/ASCE 7-10
Analysis: LRFD-AISC 14th
Chapter 16: Section 1609.3.1
Ultimate Wind Speed $V_{ult} = 140$ mph
Nominal Wind Speed $V_{nom} = 108.4$ mph
Risk Category: II $V_{nom} = V_{ult} \sqrt{0.6}$
Exposure: C

FOUNDATION DESIGN CRITERIA

This concrete foundation has been designed in accordance with ACI 318-11. Allowable lateral soil pressure = 100psf/ft with 2x increase applied. Concrete Shall Develop a Minimum Compressive Strength of 2500psi in 28 Days. Verify Site Conditions Prior to Construction.



| | |
|----------|--------------|
| Drawn | DBP |
| Checked | WML |
| EAC Job# | 100z2616 |
| Filename | 100x2616.dwg |
| Created | 9/19/2017 |



CLIENT:
Accent Sign & Awning
6015 Skyline Drive
Houston, TX 77057


11'-0" OAH ATM CANOPY
Comm. Banks of Colorado #3566
9490 E. Hampden Ave.
Aurora, CO 80231

| Revisions | | |
|-----------|--|--|
| | | |
| | | |
| | | |


Sheet No.
S-2

Sign Company to Use Experienced Excavation Crew to Perform Foundation Excavation.


Where Required, Place Electrical Conduit in Foundation Prior to Concrete Pour.

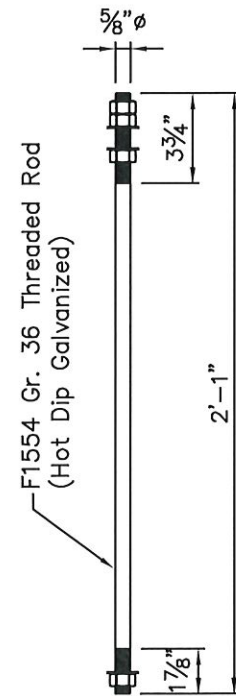


Anchor Bolt Detail
SCALE: 1 1/2" = 1'-0"

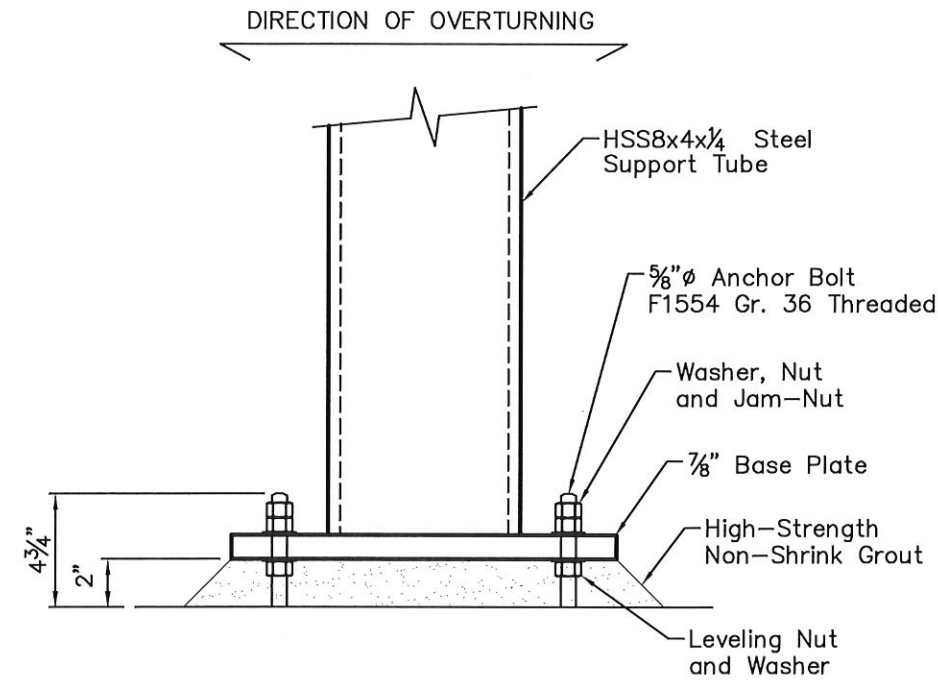

Anchor Bolt Projection Detail
SCALE: 1 1/2" = 1'-0"

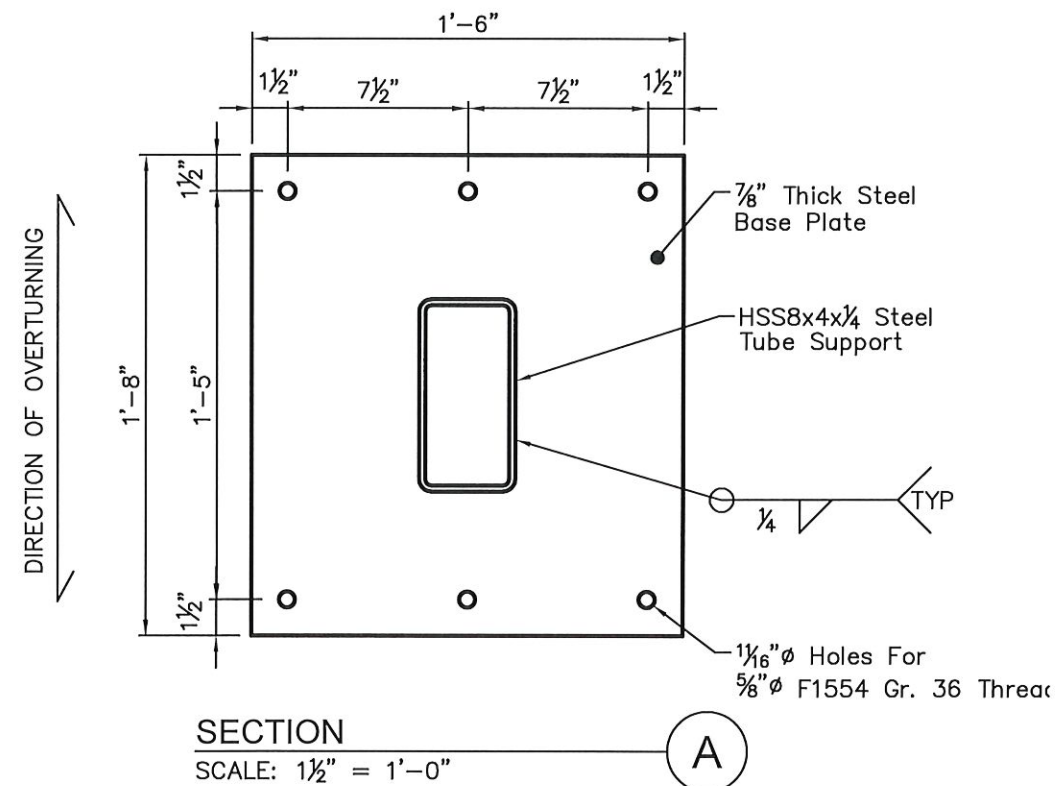

SECTION A
SCALE: 1 1/2" = 1'-0"

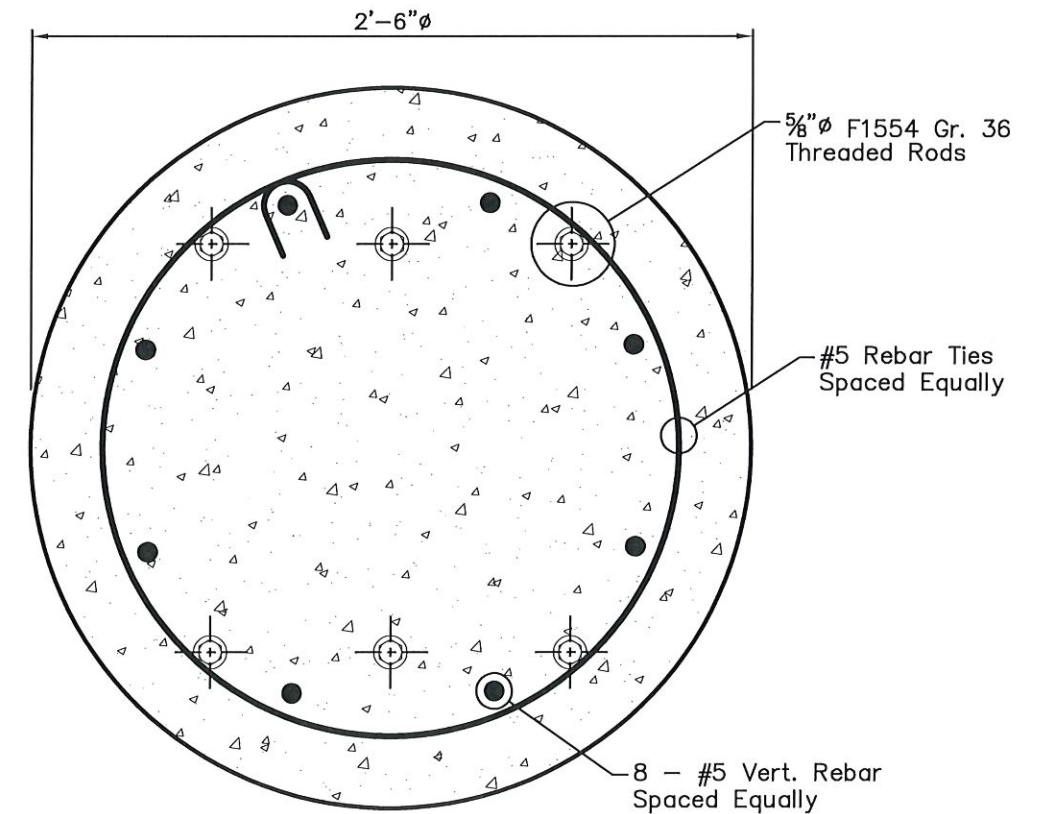

SECTION B
SCALE: 1 1/2" = 1'-0"

DESIGN CRITERIA

Building Code: IBC 2012/ASCE 7-10
Analysis: LRFD-AISC 14th
Chapter 16: Section 1609.3.1
Ultimate Wind Speed $V_{ult} = 140$ mph
Nominal Wind Speed $V_{asd} = 108.4$ mph
Risk Category: II $V_{asd} = V_{ult} \sqrt{0.6}$
Exposure: C

| | |
|----------|--------------|
| Drawn | DBP |
| Checked | WML |
| EAC Job# | 100z2616 |
| Filename | 100x2616.dwg |
| Created | 9/19/2017 |



CLIENT:

Accent Sign & Awning
6015 Skyline Drive
Houston, TX 77057

DETAILS

Comm. Banks of Colorado #3566
9490 E. Hampden Ave.
Aurora, CO 80231

Revisions

| | | | |
|--|--|--|--|
| | | | |
| | | | |
| | | | |
| | | | |

Sheet No.

S-3



| | |
|----------------|--------------------|
| Design Code: | IBC 2012/ASCE 7-10 |
| Wind Speed: | 140mph |
| Exposure: | C |
| Risk Category: | I |
| Wind load: | 57.9 PSF |

| | |
|---------------|------------------------------------|
| Project #: | 100z2616 |
| Date: | 9/19/2017 |
| Facility Ref: | CBC # 3566 |
| Address: | 9490 E. Hampden Ave. Aurora, CO |

| 1st Stage | | | | | | |
|--------------|-----------|------------|--------------|-----------|--------------------------|--------------------------|
| Area (sf) | % of Load | Load (psf) | Shape factor | Shear (k) | Base Stage Centroid (ft) | Base Stage Moment (k-ft) |
| 63.75 | 70% | 57.9 | 1 | 2.58 | 9.08 | 23.47 |
| 14.33 | 100% | 57.9 | 1 | 0.83 | 3.58 | 2.97 |
| 0.00 | 100% | 57.9 | 1 | 0.00 | 0.00 | 0.00 |
| 0.00 | 100% | 57.9 | 1 | 0.00 | 0.00 | 0.00 |
| 0.00 | 100% | 57.9 | 1 | 0.00 | 0.00 | 0.00 |
| 0.00 | 100% | 57.9 | 1 | 0.00 | 0.00 | 0.00 |
| 0.00 | 100% | 57.9 | 1 | 0.00 | 0.00 | 0.00 |
| 0.00 | 100% | 57.9 | 1 | 0.00 | 0.00 | 0.00 |
| base $V_x =$ | | | | 3.41 | base $M_x =$ | |
| | | | | | 26.44 | |

nominal $h = 8.0000$

nominal $b = 4.0000$

nominal $t = 0.2500$

outside radius $r = 0.4650$

inside radius $r_i = 0.2325$

design $t = 0.2325$

Half Radiused Corners

$A_{RC} = 0.2547$

$\bar{y}_{RC} = 0.2302$

$I_{RC} = 0.0037$

Half Total

$A_T = 2.6123$

$\bar{y}_T = 2.5405$

$Z = 13.273$

$A = 5.225$

$I = 42.463$

$S = 10.616$

| | | |
|--------------------|--------------|--|
| Z = | 13.27 | |
| $F_y =$ | 46 | $F_y = 46$ (HSS Square or HSS Rectangular) |
| $\phi =$ | 0.9 | |
| $M_n = F_y Z =$ | 50.9 | |
| $\phi M_n =$ | 45.79 | |
| Load Factor (LF) = | 1 | |
| $M_u = LF(M_n) =$ | 26.44 | |
| | < | 45.79 |
| 8.00" Tall x | 4.00" Wide x | 0.250" Wall |
| | | 57.7% OK |

Flange in Flexural Compression $b/t = 13.2$

Compact Flange b/t Limit: $1.12(E/F_y)^{0.5} = 28.1$

Non-Compact Flange b/t Limit: $1.40(E/F_y)^{0.5} = 35.2$

$b = 3.070$

Is Flange Compact? Yes. Yielding Controls (F7-1)

Is Section Non-Compact? Yes. Use Lesser of (F7-1) AND (F7-2)

Flange Is Not Slender

Yielding Check

$$(F7-1) M_n = M_p = F_y Z = 50.9$$

(GOVERNING EQUATION)

Compression Flange Local Buckling

Non-Compact Flanges

$$(F7-2) M_n = M_p - (M_p - F_y S_x) (3.57 b/t (F_y/E)^{0.5} - 4.0) = 72.5$$

Slender Walled Flanges

$$b_e = 1.92 t (E/F_y)^{0.5} [1 - (0.38 / (b/t) (E/F_y)^{0.5})] = 3.109$$

$$I_e = 42.739$$

$$S_e = 10.685$$

$$(F7-3) M_n = F_y S_e = 41.0$$

If Compact=(F7-1) OR If Non-Compact=(F7-2) OR If Slender=(F7-3) 50.9

Yielding and Flange Local Buckling Result: $M_n = 50.9$

Web in Flexure

$h/t = 30.4$

$h = 7.070$

Compact Web h/t Limit: $2.42(E/F_y)^{0.5} = 60.8$


Is Web Compact? Yes. Web Buckling N/A. Use Yield & Flange Result

Non-Compact Web h/t Limit: $5.70(E/F_y)^{0.5} = 143.1$

Is Web Non-Compact? Yes. Use Lesser of (F7-5) AND Yield & Flange Result

$$(F7-5) M_n = M_p - (M_p - F_y S_x) (0.305 h/t_w (F_y/E)^{0.5} - 0.738) = 54.6$$


Overall Result $M_n = 50.9$

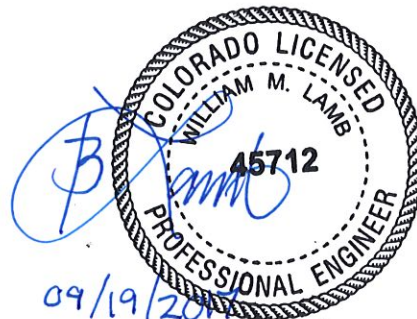

Sheets C1 → C7

Elrod Engineering, LLC
 871 Seven Oaks Blvd.
 Suite #220
 Smyrna, TN 37167

C2

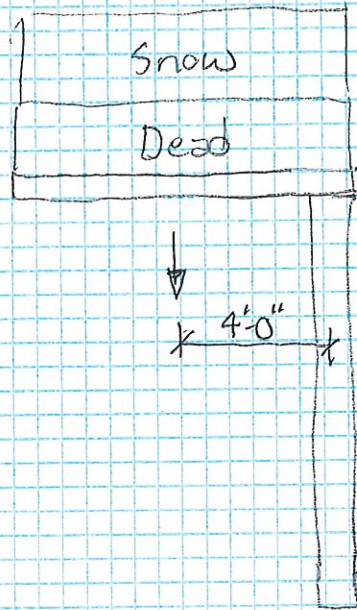

$$\underline{\underline{M_D = .015(6)8(4) = 2.88 \text{ k-ft}}}$$

$$\underline{\underline{M_S = .032(6)8(4) = 6.14 \text{ k-ft}}}$$

$$\begin{aligned} \underline{\underline{M_W}} &= .0579(3.833)12(.7)9.083 + \\ &\quad .0579(2)7.17(3.585) \\ &= \underline{\underline{19.91 \text{ k-ft}}} \end{aligned}$$

$$p_f = 0.7 C_e C_t I_s p_g = 0.7(1.2)1.2(0.8)40 = 32.2 \text{ psf}$$

$$\textcircled{3} M = 1.2D + 1.6S + 0.5W = 1.2(2.88) + 1.6(6.14) + 0.5(19.91) = 23.24 \text{ k-ft}$$

$$\textcircled{4} M = 1.2D + 1.0W + 0.5S = 1.2(2.88) + 1.0(19.91) + 0.5(6.14) = \underline{\underline{26.44 \text{ k-ft}}}$$

Analysis of Steel Base Plate w/ Steel Anchor Bolts

(AISC Steel Construction Manual - 14th Edition - LRFD)

ASCE 7- 10 Enter "05" or "10"

| | |
|---------------------|---|
| $PL_{th} = 0.875$ | (in.) Plate Thickness |
| $PL_{bl} = 18$ | (in.) Plate Bend Line Length (See Sketches for Examples) |
| $L_c = 4.5$ | (in.) Cantilever Length of Plate (See Sketches for Examples) |
| $PL_{fy} = 36$ | (ksi) Plate Material Yield Stress $F_y = 36(A36)$ |
| $PL_{fu} = 58$ | (ksi) Plate Material Ultimate Tensile Stress $F_u = 58(A36)$ |
| $B_{dia} = 0.625$ | (in.) Anchor Bolt Diameter |
| $n_b = 6$ | (Qty) Total Number of Anchor Bolts in the Base Plate (Symmetrical) |
| $d = 17$ | (in.) Distance Between Bolts (In Direction of Overturning) |
| $F_u = 58$ | (ksi) Bolt Material Ultimate Tensile Stress $F_u = 58(F1554 \text{ Gr } 36), =75(Gr55), =125(Gr105), \text{ or } =60(A307)$ |
| Threads Excluded? N | (Yes or No) Are Threads Excluded From the Shear Plane? |
| $M = 26.44$ | (kip-ft) Bending Moment at Match Plate (Unfactored Load Effects) |
| $V = 3.41$ | (kip) Shear Force at Match Plate (Unfactored Load Effects) |
| $A_b = 0.3068$ | (in ²) Nominal Area of Anchor Bolt = $\pi r^2 = \pi(B_{dia}/2)^2$ |
| $F_{nv} = 26.1$ | (ksi) Bolt Nominal Shear Stress $F_{nv} = 0.45F_u(\text{Threads Excluded}) \text{ or } 0.563F_u(\text{Threads Not Excluded})$ |
| $F_{nt} = 43.5$ | (ksi) Bolt Nominal Tensile Stress $F_{nt} = 0.75F_u(F1554 \text{ Gr } 36 \text{ or } A307)$ |

| ANCHOR BOLT | | | |
|---|--|-------|-----|
| Shear | | | |
| Single Bolt Available Shear Capacity = $\Phi R_n = \Phi(F_{nv})A_b =$ | | 6.01 | kip |
| Single Bolt Actual Shear Force = $V_u/n_b =$ | | 0.57 | kip |
| Shear Check | | OK | 9% |
| Tension (Modified for Shear) | | | |
| Single Bolt Required Shear Stress = $f_{rv} = (V_u/n_b)/A_b =$ | | 1.9 | ksi |
| Modified Bolt Nominal Tension Stress = $F'_{nt} = 1.3F_{nt} - (F_{nt}/\Phi F_{nv})f_{rv} =$ | | 43.5 | ksi |
| Single Bolt Available Tension Capacity = $\Phi R_n = \Phi(F'_{nt})A_b =$ | | 10.01 | kip |
| Single Bolt Actual Tension Force = $T_u = (M_u/d)/(0.5n_b) =$ | | 6.22 | kip |
| Tension Check | | OK | 62% |
| USE: 0.625 Inch Diameter Anchor Bolts | | | |

| BASE PLATE | | | |
|--|--|-------|-----------------|
| Flexure | | | |
| Plate Plastic Section Modulus = $Z = PL_w(PL_{th})^2/4 =$ | | 3.445 | in ³ |
| Plate Available Flexural Strength = $\Phi M_n = \Phi(PL_{fy})Z =$ | | 111.6 | in-kip |
| Cumulative Bolt Tension Force = $T_{uc} =$ | | 18.7 | kip |
| Plate Actual Bending Moment = $M_{pl} =$ | | 84.0 | in-kip |
| Flexure Check | | OK | 75% |
| Bearing | | | |
| Plate Available Bearing Strength at Bolt = $\Phi R_n = \Phi(3.0)B_{dia}(PL_{th})PL_{fu} =$ | | 71.4 | kip |
| Plate Actual Bearing Stress = $(V_u/n_b)/(B_{dia}(PL_{th})) =$ | | 1.0 | kip |
| Bearing Check | | OK | 1% |
| USE: 0.875 Inch Thick Base Plate | | | |

C4

(ROUND) PIER FOUNDATION ANALYSIS

| | |
|------------|-----------|
| Date: | 9/19/2017 |
| Project #: | 100z2616 |

Section 1807.3.2.1 (Unconstrained) --> $d = 0.5A \{1 + [1 + (4.36h/A)]^{1/2}\}$

Store:

| | | |
|---|-----------------------------------|----------|
| P = Applied Lateral Force - kips | 3.41 | <- |
| M = Moment @ Base - k-ft | 26.44 | <- |
| S_o = Lateral Bearing Pressure (psf/ft of Depth) (Table 1819.6) | 100.00 | <- |
| Diameter of Support Embedded into Concrete - in. | 0.000 | <- |
| b = Diameter of Footing - ft. | 2.50 | <- |
| d = Depth of Footing - ft. | 7.750 | <- |
| Dmin | 7.749 | |
| Load Combination Factor For (W)= | ASCE 7-05 = 1.0 ASCE 7-10 = .6 | 0.60 |
| Factored Shear | | 2046.00 |
| Factored Moment | | 15864.00 |
| TEST | 1500.00 516.67 | 516.67 |
| $S_1 = 2 \times (d/3) \times (S_o)$ | | 516.67 |
| $A = (2.34P) / (S_1 \times b)$ | | 3.707 |
| h = Centroid of Moment | | 7.754 |

Reinforcement Design (Use w/Anchor Bolts)

If Support is Direct Embed into Concrete Disregard Reinforcement

| | | |
|--|-----------|---|
| $d=$ | 15.3333 | |
| $b=$ | 29.4524 | |
| $M_u = (Moment * Load Factor) =$ | 26440 | |
| Load Factor = | 1.00 | <- |
| $f_y =$ | 60000 | <- |
| $f'_c =$ | 2500 | <- |
| $\alpha =$ | 1 | <- |
| $\alpha = A_s f_y / (0.85 f'_c b) =$ | 0.759 | |
| Req'd Flexural Steel = $A_s = ((M_u * 12) / (.9 * 60,000 (d - \alpha/2))) * 2 =$ | 0.792 | $\rho = (\#_{bars} * Area_{bar}) / (\pi * r^2)$ |
| Req'd Temp & Shrinkage Steel = $A_s = 0.0018 (A_g) =$ | 1.272 | |
| DEPTH: | 7.75 ft. | |
| DIAMETER: | 2.5 ft. | |
| (support filled) CONC. VOL: | 1.409 cy. | |
| (support not filled) CONC. VOL: | 1.409 cy. | |

C5

Elrod Engineering, LLC

Project : 100x2616 Comm. Banks of Colorado
 Subject : 11'-0" ATM Canopy
 Location : Multiple Location, CO

File : 100x2161
 Date : 9/18/2017
 Eng : DBP

Design Wind Pressure, p, Equation 29.4-1 (ASCE 7-10)

| System Type | Structure Type | Equation |
|---|--|---|
| Other Structures (Directional Procedure) | Rigid Structures of all Heights Solid Freestanding Walls & Solid Freestanding Signs | $p = qh G C_f$ qh : velocity pressure at h G : Section 26.9.4 C_f : Figure 29.4-1 $F = p A_s$ A_s : gross area of wall or sign |

Velocity Pressure Calculations:

Velocity pressure q_h is calculated in accordance with section 29.3.2.

q_h = Velocity pressure @ height (h)

$q_h = \text{Constant} \cdot K_z \cdot K_{zt} \cdot K_d \cdot V^2$

(Eq 29.3-1)

Where : Constant

= Numerical Constant

(Section C27.3.2)

= $\frac{1}{2} \cdot [(\text{Air density lb/ cu ft}) / (32.2 \text{ ft/s}^2)] \cdot [(\text{mi/h}) (5280 \text{ ft/mi}) \cdot (1 \text{ hr/3600 s})]^2$

= 0.00256

Mean Sea Level

= 0.00 ft

Air Density @MSL

= 0.0765 lb/cu ft

(Table C27.3-2)

Occupancy Category

= II

(Table 1.5-1)

Exposure Category

= C

(Section 26.7.3)

α

= 9.50

(Table 26.9-1)

Z_g

= 900.00 ft

(Table 26.9-1)

Basic Wind Speed

= 140.00 mph

(Figure 26.5-1 A-C)

Structure Height

= 11.00 ft

Width

= 12.00 ft

Depth

= 2.00 ft

Where : K_h

= Velocity pressure coefficient @ height h

= $2.01 \cdot (Z/Z_g)^{2/\alpha}$ for $15 \text{ ft} \leq Z \leq Z_g$

(Table 29.3-1)

= $2.01 \cdot (15/Z_g)^{2/\alpha}$ for $Z < 15 \text{ ft}$

= 0.85

K_{zt}

= Topographic factor

(Figure 26.8-1)

= $(1 + K_1 \cdot K_2 \cdot K_3)^2$

Topography

= None

$K_{zt} @ h$

= 1.00

(Table 26.6-1)

K_d

= Wind directionality factor

= 0.85

C6

Elrod Engineering, LLC

Project : 100x2616 Comm. Banks of Colorado
 Subject : 11'-0" ATM Canopy
 Location : Multiple Location, CO

File : 100x2161
 Date : 9/18/2017
 Eng : DBP

Gust Effect Factor, G_f , Obtained by Rational Analysis

The gust effect factor G_f obtained by rational analysis uses the dynamic properties of the system.

Values Obtained from Table 26.9-1

Z_{min} = 15 ft
 e = 0.2
 ℓ = 500 ft
 c = 0.2

Calculated Values

Analysis = Category II : Rigid Structure-Complete Analysis
 $z(\cdot)$ = 15 ft
 l_z = $c \cdot (33/z(\cdot))^{1/6}$ (Eq. 26.9-7)
 = 0.2280869
 L_z = $\ell \cdot (z(\cdot)/33)^{1/e}$ (Eq. 26.9-9)
 = 427.0566 ft
 Q = $Sqr [1 / (1 + 0.63 \cdot [(b+h)/L_z]^{0.63})]$ (Eq. 26.9-8)
 = 0.953
 g_q = 3.4
 g_v = 3.4
 Gust Factor (G) = $0.925 \cdot [(1 + 1.7 \cdot g_q \cdot l_z \cdot Q) / (1 + 1.7 \cdot g_v \cdot l_z)]$ (Eq. 26.9-6)
 G = 0.901

Elrod Engineering, LLC

Project : 100x2616 Comm. Banks of Colorado
 Subject : 11'-0" ATM Canopy
 Location : Multiple Location, CO

File : 100x2161
 Date : 9/18/2017
 Eng : DBP

Design Wind Pressure, p, Equation 29.4-1

Figure 29.4-1 (Solid Freestanding Walls & Freestanding Solid Signs)

Horizontal dimension of sign (B) = 12.00 ft
 Height of sign from ground surface to top (h) = 11.00 ft
 Vertical dimension of sign (s) = 3.83 ft
 Ratio of solid area to gross area (epsilon) = 1.00
 Horizontal dimension of return corner (Lr) = 2.00 ft
 Aspect Ratio (B/s) = 3.13
 Clearance Ratio (s/h) = 0.35
 Depth Ratio (Lr/s) = 0.52

| Case | kz | K3 | Kzt | Kd | qh (psf) | Cf | p (psf) | F (lbs) |
|------|------|------|------|------|----------|------|---------|----------|
| A&B | 0.85 | 1.00 | 1.00 | 0.85 | 36.20 | 1.78 | 57.90 | 2,662.96 |

Case C

| Region | kz | K3 | Kzt | Kd | qh (psf) | Cf | p (psf) | F (lbs) |
|----------|------|------|------|------|----------|------|---------|----------|
| 0 to s | 0.85 | 1.00 | 1.00 | 0.85 | 36.20 | 2.64 | 86.05 | 1,264.18 |
| s to 2s | 0.85 | 1.00 | 1.00 | 0.85 | 36.20 | 1.73 | 56.28 | 826.82 |
| 2s to 3s | 0.85 | 1.00 | 1.00 | 0.85 | 36.20 | 1.17 | 38.13 | 560.24 |
| 3s to 4s | 0.85 | 1.00 | 1.00 | 0.85 | 36.20 | 0.14 | 4.69 | 9.00 |

Sum = 2,660.24